

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 2 October 2012	15,318 MW	15,358 MW	0.26%	
Energy Demand for 2 October 2012	319.29 GWh	319.07 GWh	-0.07%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

03-Oct-12


Daily Owners' Mix for 2 October 2012

TNB	78,368 MWh
IPP	238,976 MWh
Co-Gen	2,029 MWh
Interconnection*	295 MWh

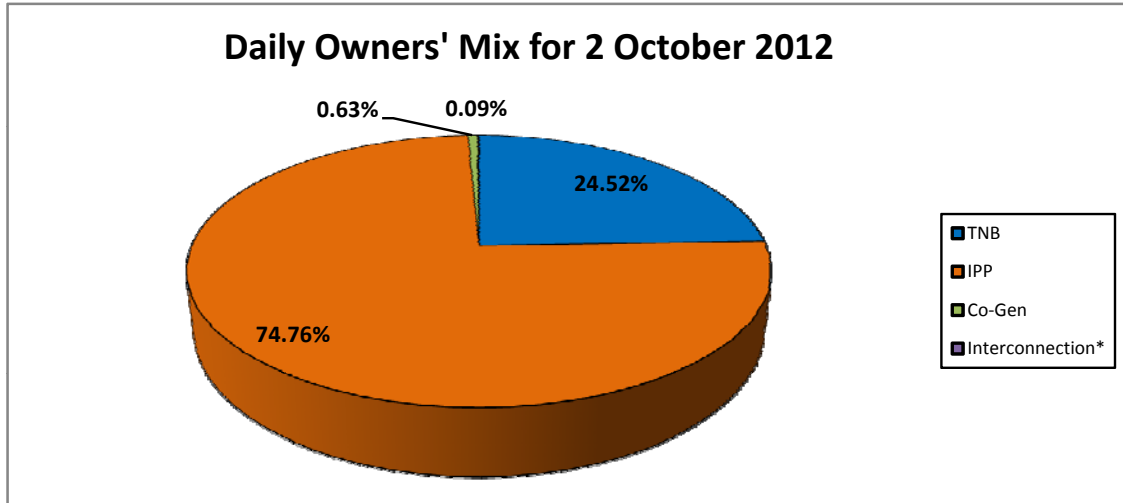

Daily Generation Mix for 2 October 2012

ST-Coal	137,592 MWh
ST-Oil	12,377 MWh
ST-Gas	- MWh
Gas	118,975 MWh
Hydro	11,606 MWh
Distillate	36,794 MWh
Co-Gen	2,029 MWh
SPORE*	295 MWh
EGAT*	- MWh

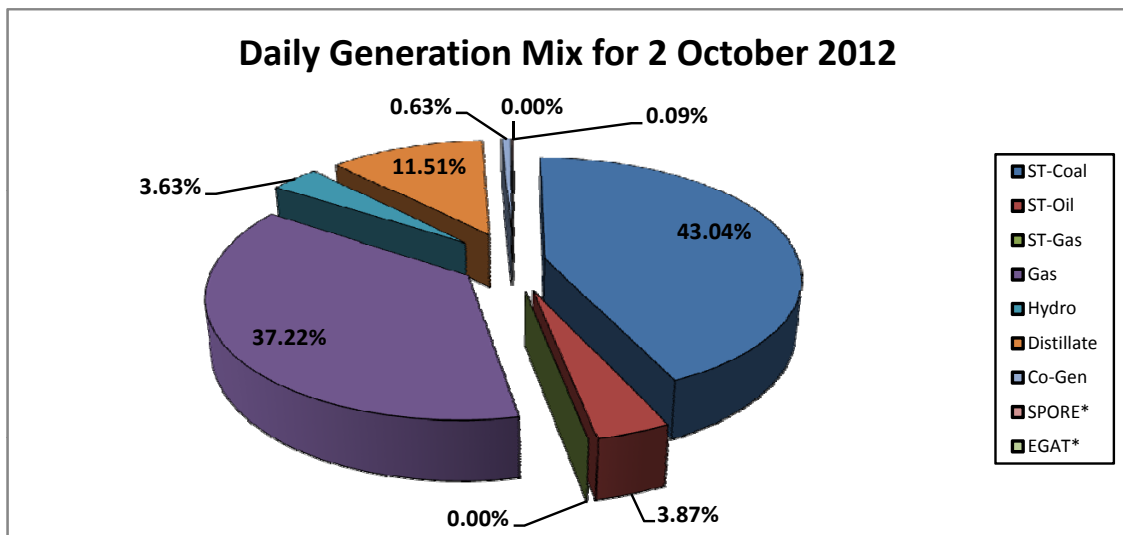

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand