

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 October 2012	15,414 MW	15,585 MW	1.11%	
Energy Demand for 3 October 2012	321.42 GWh	322.10 GWh	0.21%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Oct-12


**Daily Owners' Mix for 3 October 2012**

TNB	79,729 MWh
IPP	240,463 MWh
Co-Gen	2,082 MWh
Interconnection*	176 MWh

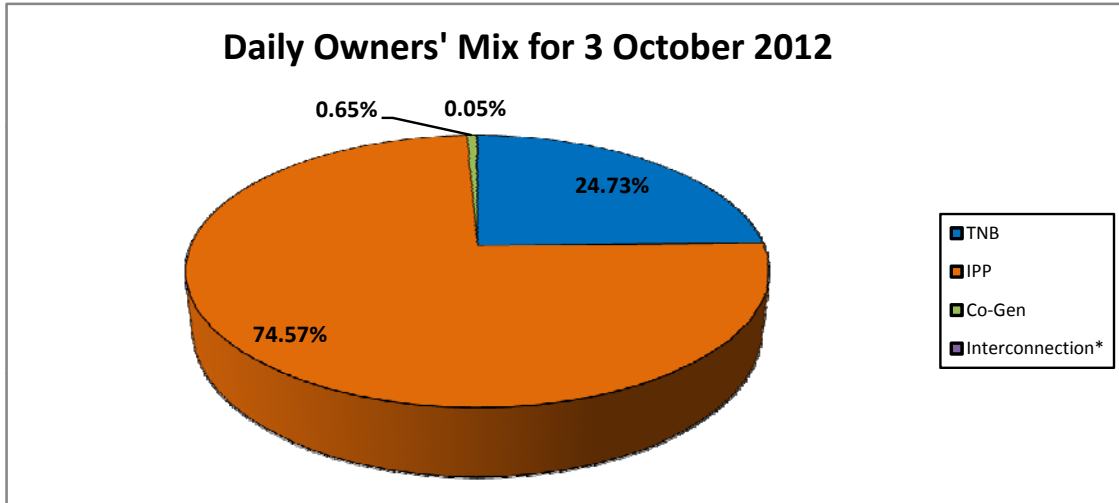

**Daily Generation Mix for 3 October 2012**

ST-Coal	127,478 MWh
ST-Oil	12,937 MWh
ST-Gas	- MWh
Gas	130,154 MWh
Hydro	16,107 MWh
Distillate	33,516 MWh
Co-Gen	2,082 MWh
SPORE*	176 MWh
EGAT*	- MWh

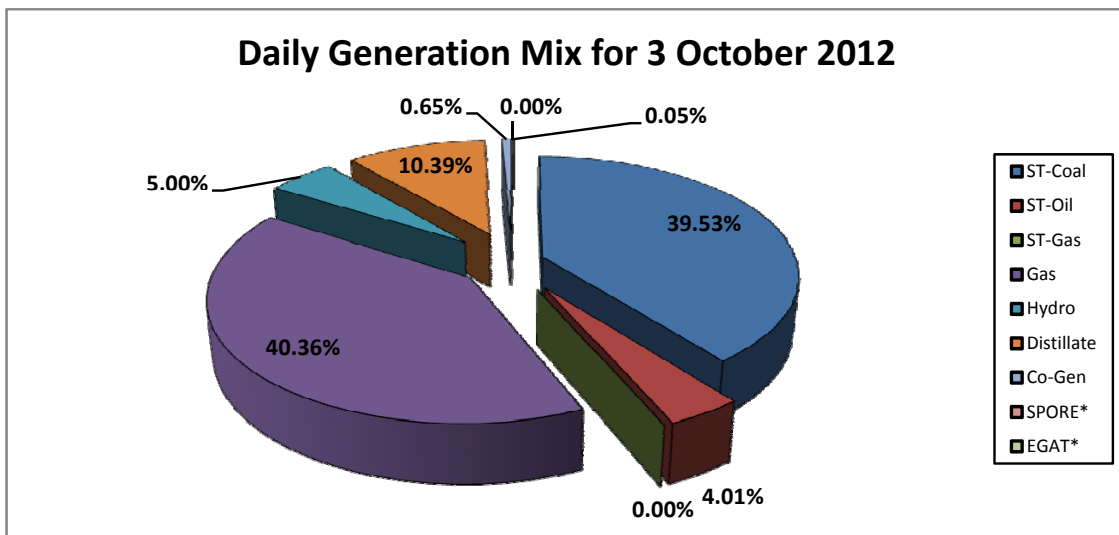

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand