

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 4 October 2012	15,448 MW	15,253 MW	-1.26%	
Energy Demand for 4 October 2012	322.25 GWh	320.29 GWh	-0.61%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

05-Oct-12


Daily Owners' Mix for 4 October 2012

TNB	80,404 MWh
IPP	237,861 MWh
Co-Gen	2,080 MWh
Interconnection*	52 MWh

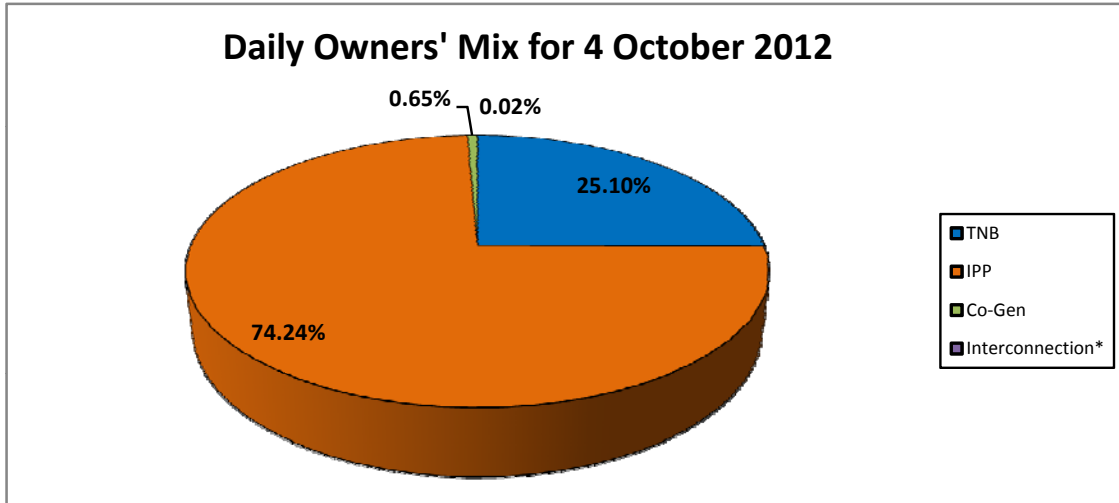

Daily Generation Mix for 4 October 2012

ST-Coal	125,539 MWh
ST-Oil	12,374 MWh
ST-Gas	- MWh
Gas	135,556 MWh
Hydro	13,849 MWh
Distillate	30,947 MWh
Co-Gen	2,080 MWh
SPORE*	52 MWh
EGAT*	- MWh

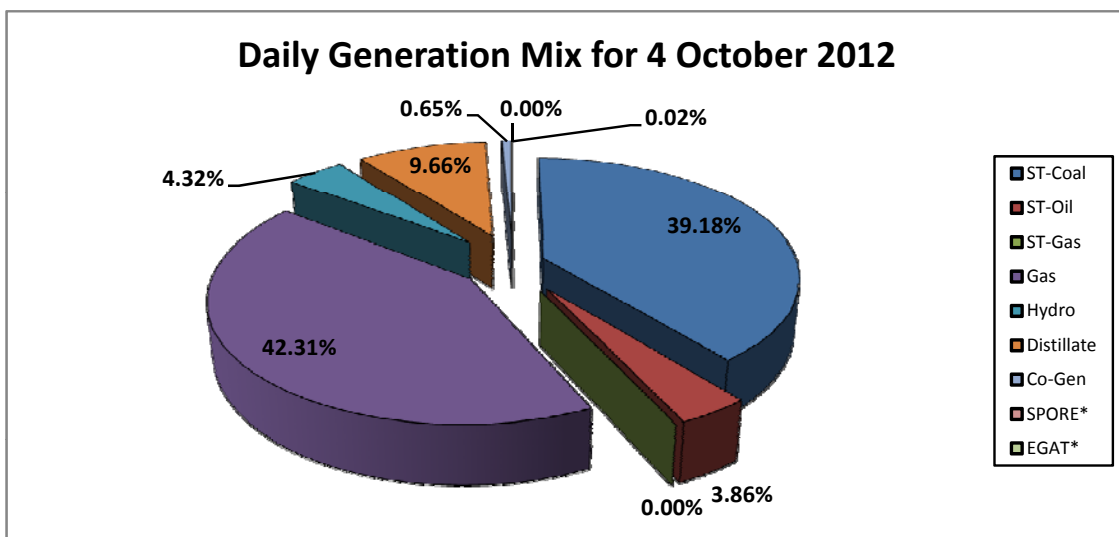

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand