

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 6 October 2012	13,278 MW	13,518 MW	1.81%	
Energy Demand for 6 October 2012	293.51 GWh	296.47 GWh	1.01%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

07-Oct-12


Daily Owners' Mix for 6 October 2012

TNB	73,420 MWh
IPP	220,244 MWh
Co-Gen	2,034 MWh
Interconnection*	(767) MWh

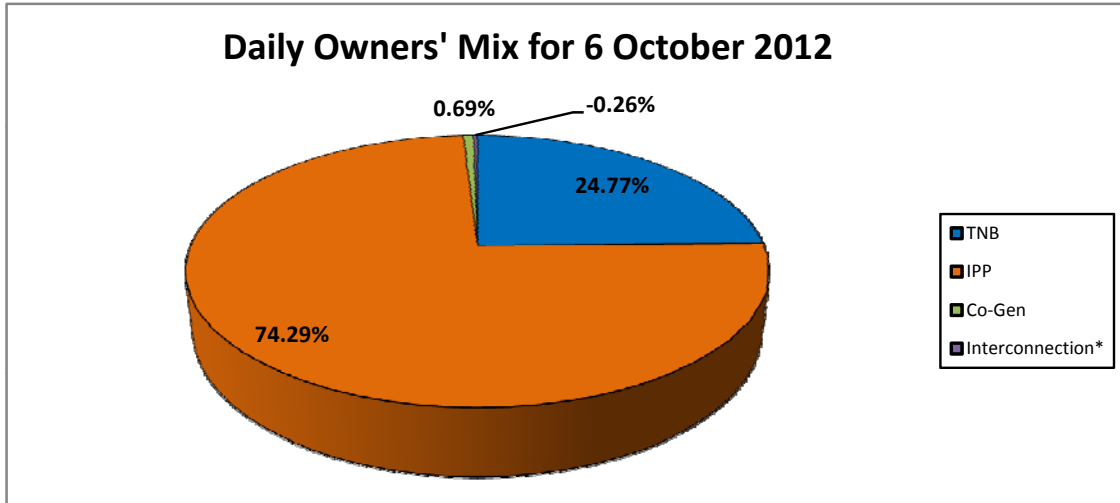

Daily Generation Mix for 6 October 2012

ST-Coal	124,182 MWh
ST-Oil	2,188 MWh
ST-Gas	- MWh
Gas	138,145 MWh
Hydro	12,416 MWh
Distillate	16,733 MWh
Co-Gen	2,034 MWh
SPORE*	(69) MWh
EGAT*	(698) MWh

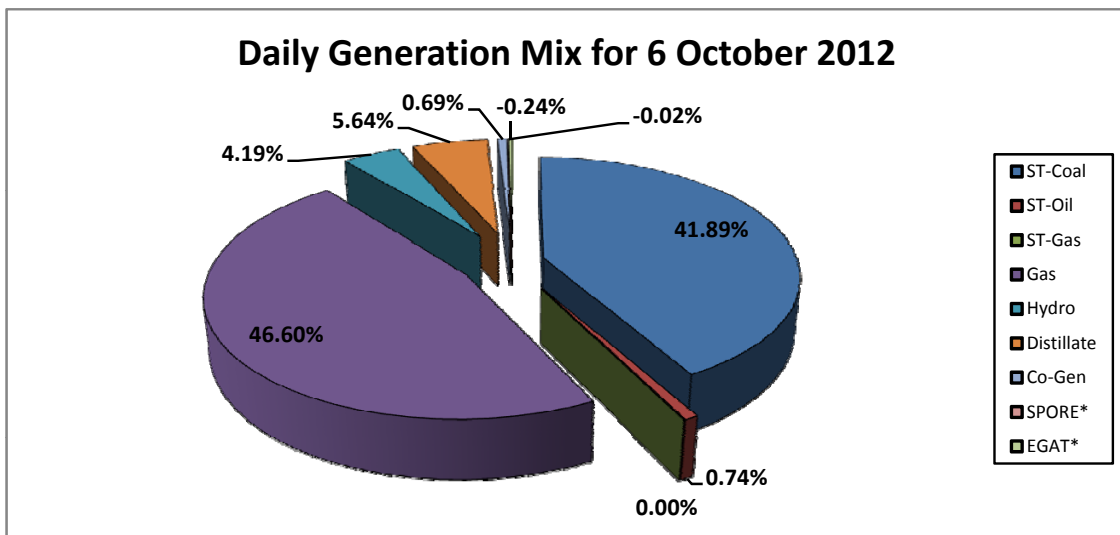

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand