

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 7 October 2012	12,841 MW	12,874 MW	0.26%	
Energy Demand for 7 October 2012	275.00 GWh	271.80 GWh	-1.16%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

08-Oct-12


Daily Owners' Mix for 7 October 2012

TNB	70,530 MWh
IPP	198,794 MWh
Co-Gen	1,898 MWh
Interconnection*	(576) MWh

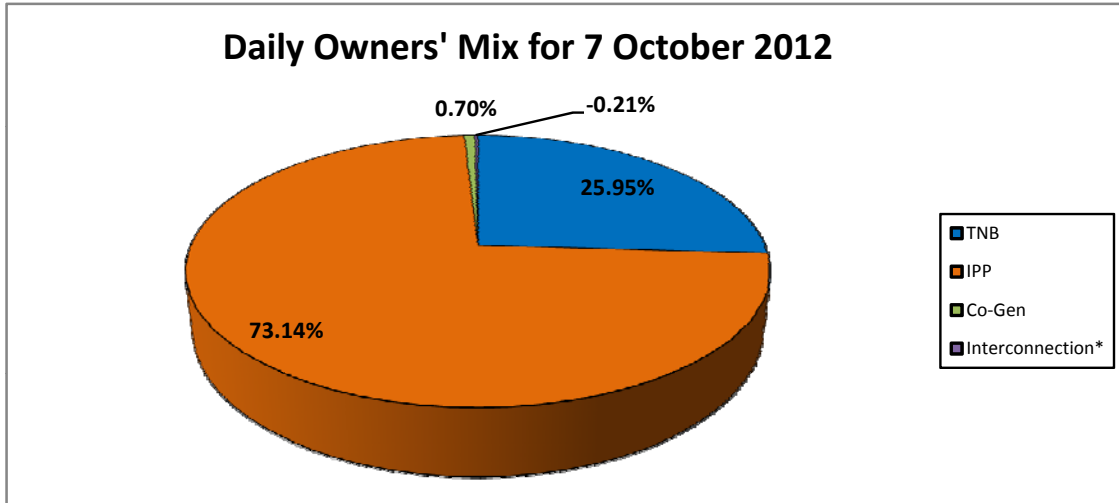

Daily Generation Mix for 7 October 2012

ST-Coal	126,300 MWh
ST-Oil	1,308 MWh
ST-Gas	- MWh
Gas	129,284 MWh
Hydro	7,999 MWh
Distillate	4,433 MWh
Co-Gen	1,898 MWh
SPORE*	122 MWh
EGAT*	(698) MWh

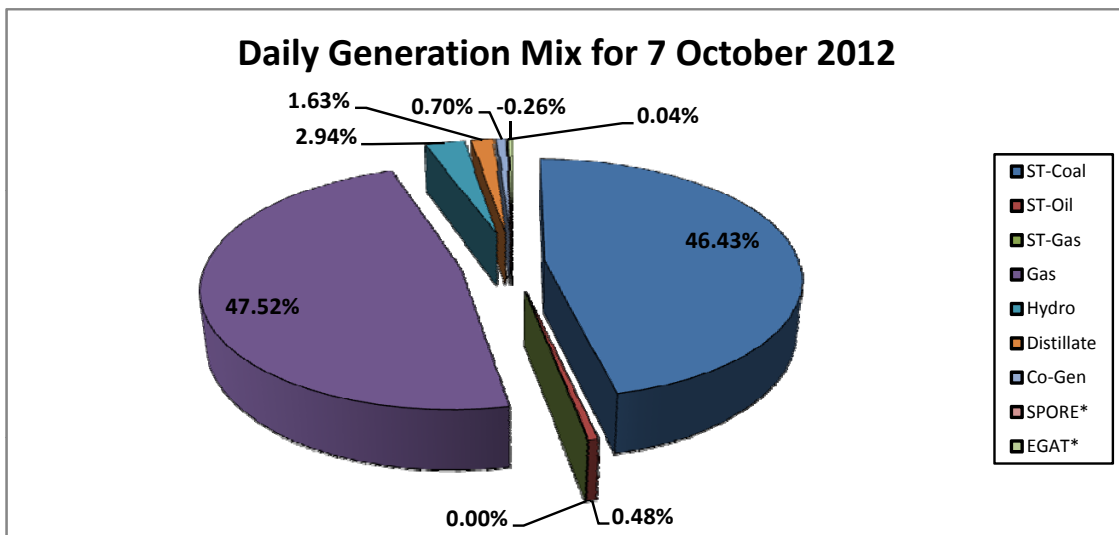

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand