

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 13 October 2012	13,163 MW	13,000 MW	-1.24%	
Energy Demand for 13 October 2012	292.29 GWh	284.30 GWh	-2.73%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

14-Oct-12


**Daily Owners' Mix for 13 October 2012**

TNB	53,873	MWh
IPP	230,107	MWh
Co-Gen	1,180	MWh
Interconnection*	859	MWh

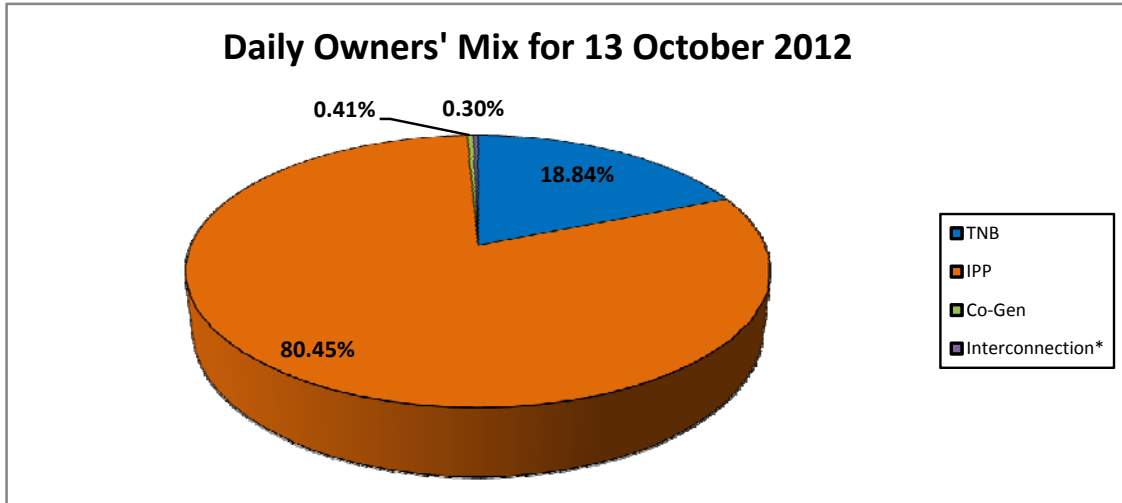

**Daily Generation Mix for 13 October 2012**

ST-Coal	160,227	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	114,929	MWh
Hydro	8,824	MWh
Distillate	-	MWh
Co-Gen	1,180	MWh
SPORE*	132	MWh
EGAT*	727	MWh

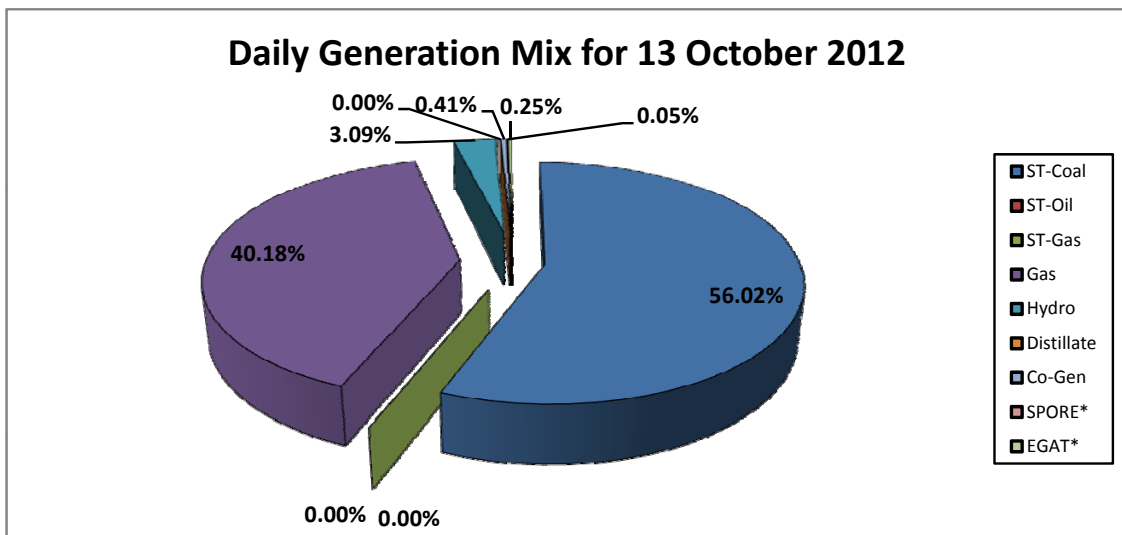

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand