

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 14 October 2012	12,781 MW	12,561 MW	-1.72%	
Energy Demand for 14 October 2012	273.65 GWh	264.11 GWh	-3.49%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

15-Oct-12


**Daily Owners' Mix for 14 October 2012**

<b>TNB</b>	58,323 MWh
<b>IPP</b>	205,257 MWh
<b>Co-Gen</b>	1,147 MWh
<b>Interconnection*</b>	617 MWh

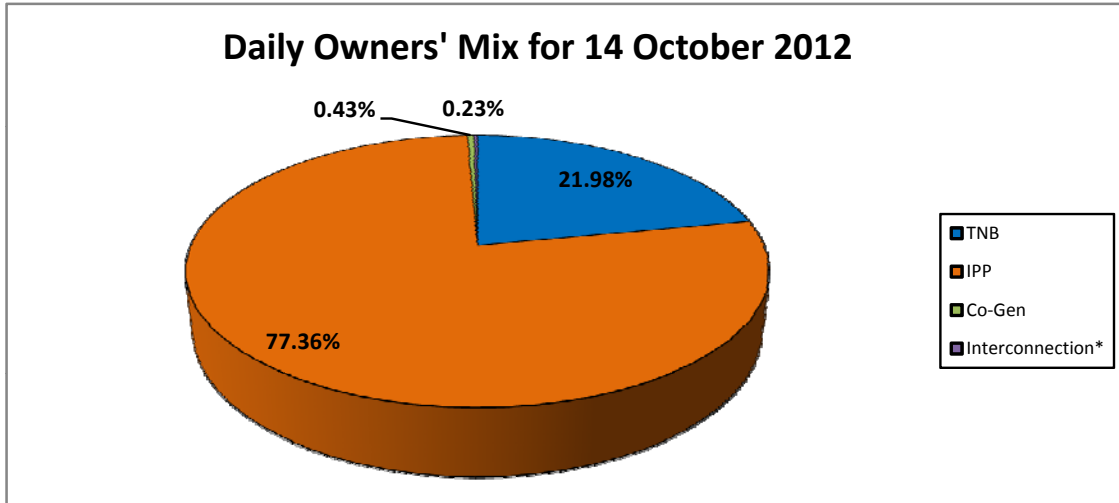

**Daily Generation Mix for 14 October 2012**

<b>ST-Coal</b>	136,680 MWh
<b>ST-Oil</b>	- MWh
<b>ST-Gas</b>	- MWh
<b>Gas</b>	116,855 MWh
<b>Hydro</b>	10,045 MWh
<b>Distillate</b>	- MWh
<b>Co-Gen</b>	1,147 MWh
<b>SPORE*</b>	(115) MWh
<b>EGAT*</b>	732 MWh

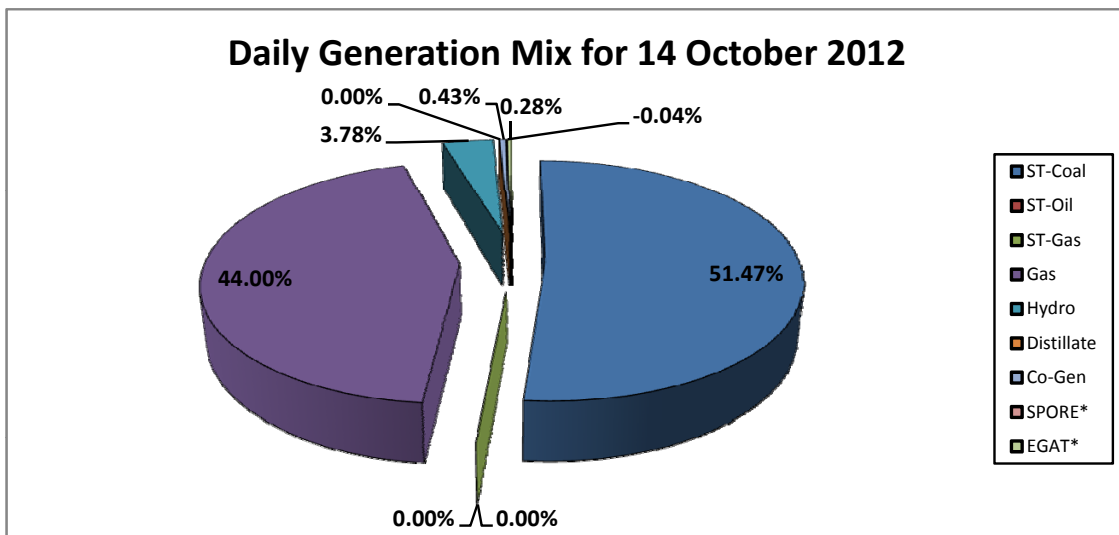

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand