

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 October 2012	15,040 MW	15,256 MW	1.44%	
Energy Demand for 16 October 2012	314.24 GWh	314.99 GWh	0.24%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Oct-12


Daily Owners' Mix for 16 October 2012

TNB	74,075 MWh
IPP	238,991 MWh
Co-Gen	1,199 MWh
Interconnection*	(729) MWh

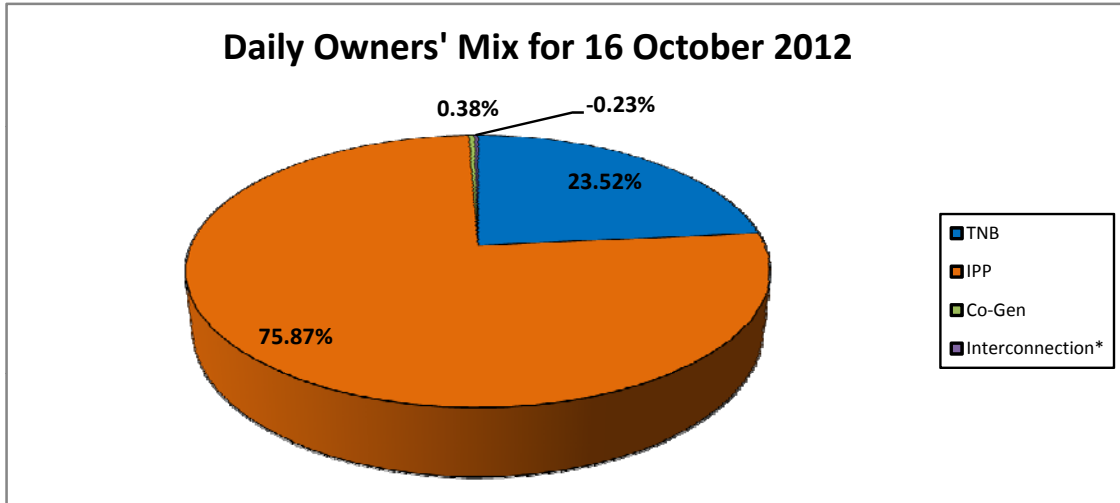

Daily Generation Mix for 16 October 2012

ST-Coal	128,399 MWh
ST-Oil	6,666 MWh
ST-Gas	- MWh
Gas	147,189 MWh
Hydro	11,156 MWh
Distillate	19,656 MWh
Co-Gen	1,199 MWh
SPORE*	(33) MWh
EGAT*	(696) MWh

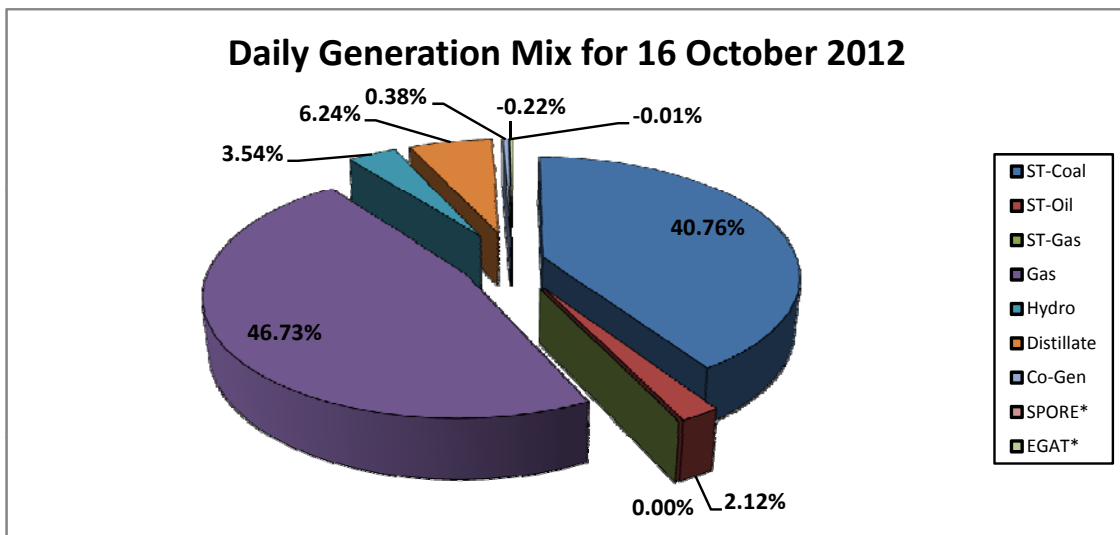

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand