

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 17 October 2012	15,007 MW	15,274 MW	1.78%	
Energy Demand for 17 October 2012	315.32 GWh	312.45 GWh	-0.91%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

18-Oct-12


Daily Owners' Mix for 17 October 2012

TNB	78,462 MWh
IPP	231,869 MWh
Co-Gen	1,440 MWh
Interconnection*	(682) MWh

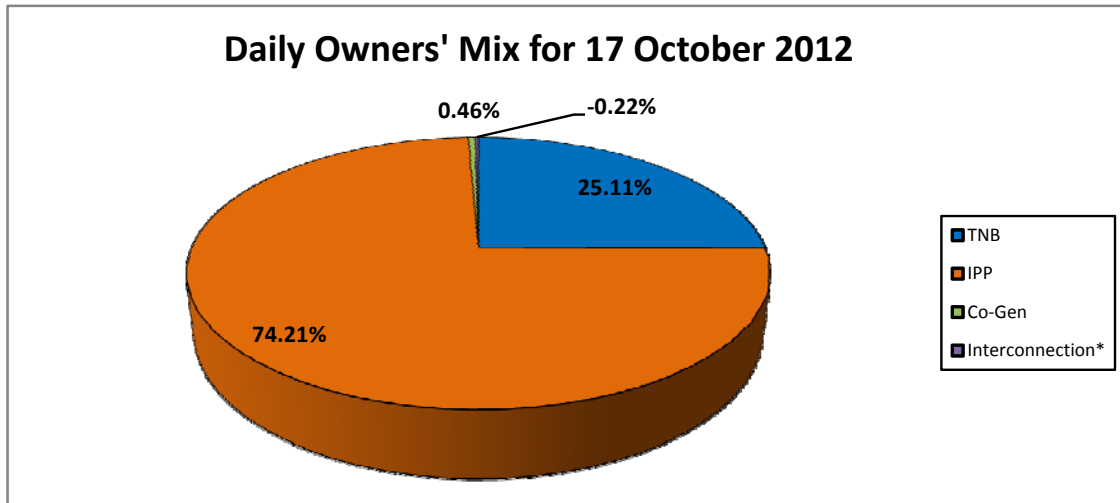

Daily Generation Mix for 17 October 2012

ST-Coal	128,059 MWh
ST-Oil	9,683 MWh
ST-Gas	64 MWh
Gas	135,131 MWh
Hydro	12,989 MWh
Distillate	24,405 MWh
Co-Gen	1,440 MWh
SPORE*	14 MWh
EGAT*	(696) MWh

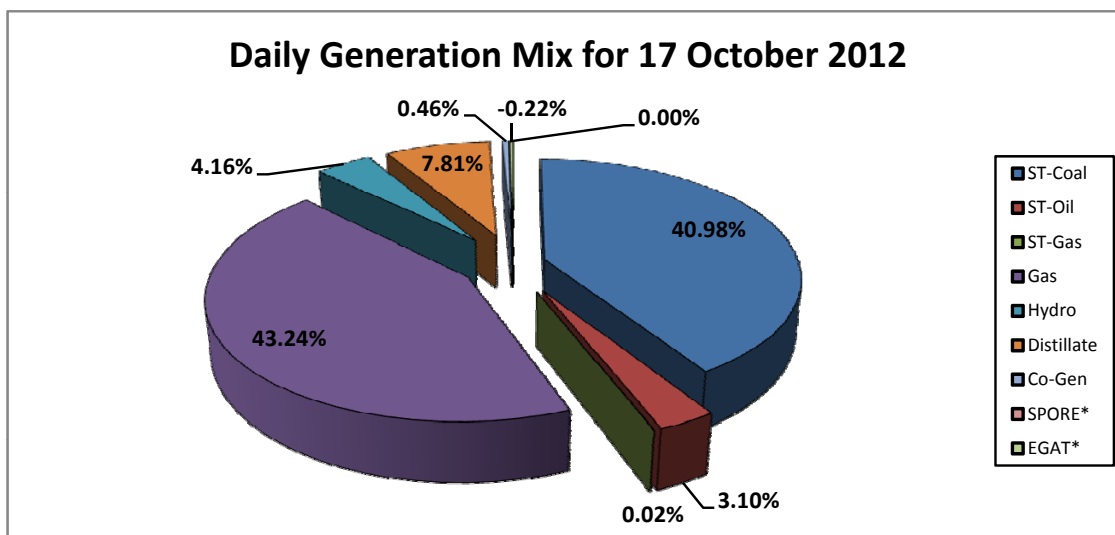

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand