

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 19 October 2012	14,709 MW	14,563 MW	-0.99%	
Energy Demand for 19 October 2012	309.72 GWh	303.02 GWh	-2.16%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

20-Oct-12


Daily Owners' Mix for 19 October 2012

TNB	71,410 MWh
IPP	229,607 MWh
Co-Gen	1,270 MWh
Interconnection*	(736) MWh

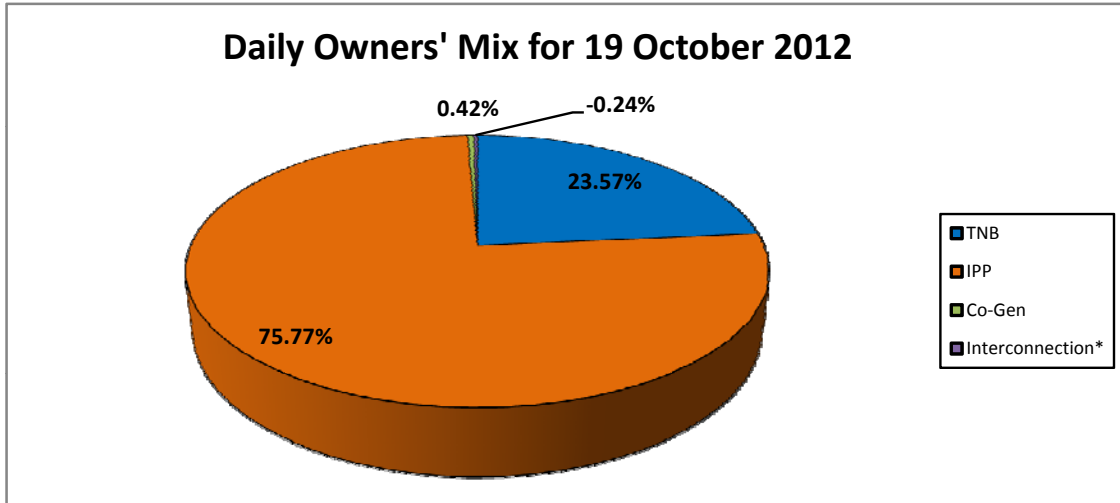

Daily Generation Mix for 19 October 2012

ST-Coal	128,115 MWh
ST-Oil	11,933 MWh
ST-Gas	51 MWh
Gas	117,165 MWh
Hydro	12,236 MWh
Distillate	31,517 MWh
Co-Gen	1,270 MWh
SPORE*	(37) MWh
EGAT*	(699) MWh

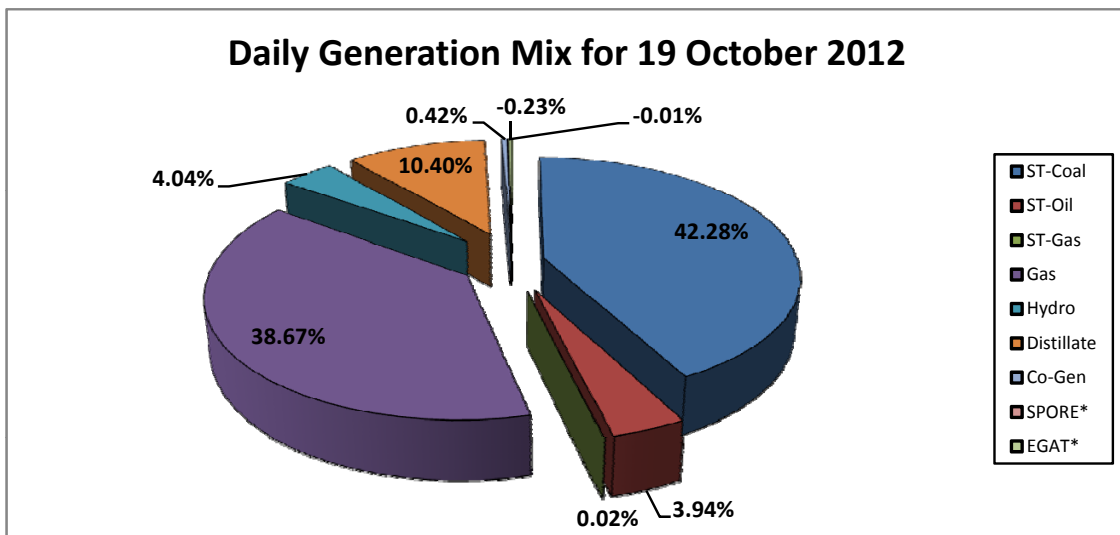

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand