

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 20 October 2012	13,201 MW	13,213 MW	0.09%	
Energy Demand for 20 October 2012	288.15 GWh	283.17 GWh	-1.73%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-Oct-12


Daily Owners' Mix for 20 October 2012

TNB	56,593 MWh
IPP	224,605 MWh
Co-Gen	1,163 MWh
Interconnection*	(806) MWh

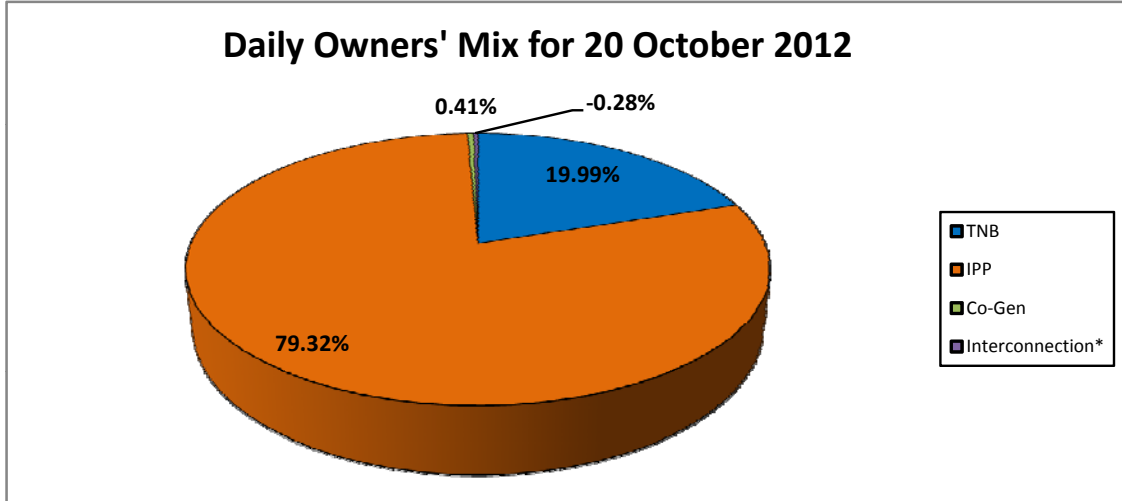

Daily Generation Mix for 20 October 2012

ST-Coal	127,445 MWh
ST-Oil	12,576 MWh
ST-Gas	- MWh
Gas	125,702 MWh
Hydro	8,228 MWh
Distillate	7,247 MWh
Co-Gen	1,163 MWh
SPORE*	(107) MWh
EGAT*	(699) MWh

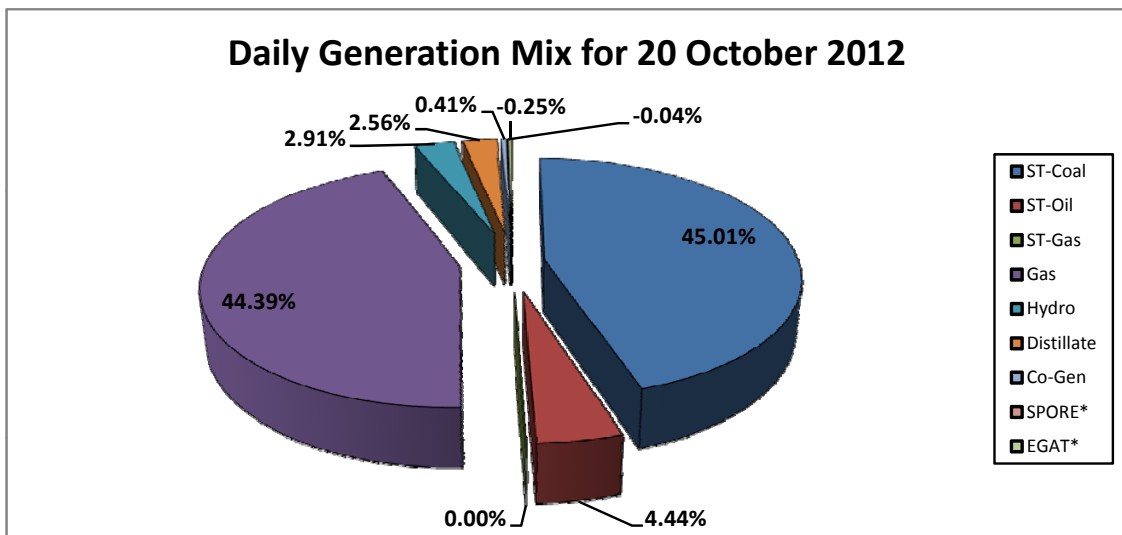

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand