

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 October 2012	14,737 MW	14,585 MW	-1.03%	
Energy Demand for 22 October 2012	300.22 GWh	298.75 GWh	-0.49%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

23-Oct-12


Daily Owners' Mix for 22 October 2012

TNB	72,326 MWh
IPP	225,133 MWh
Co-Gen	1,298 MWh
Interconnection*	11 MWh

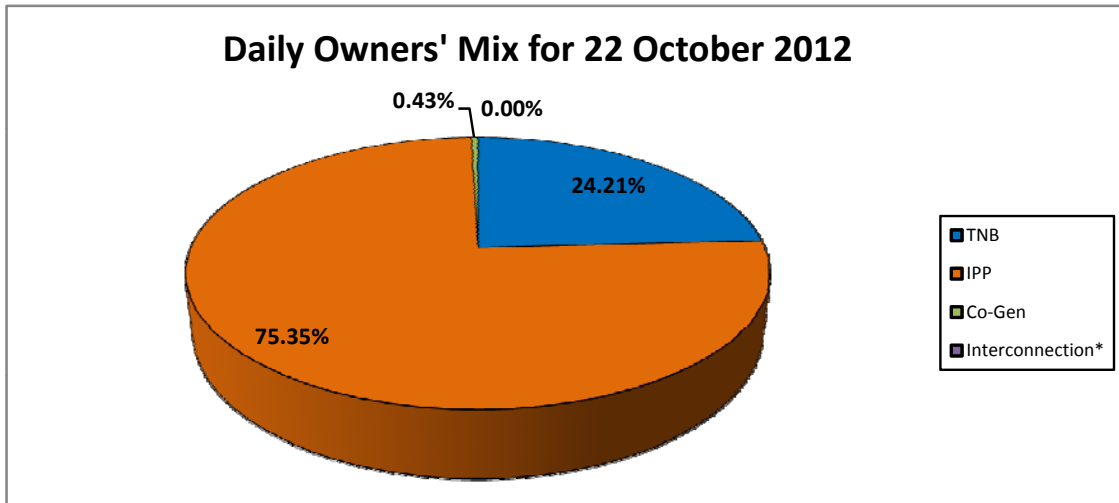

Daily Generation Mix for 22 October 2012

ST-Coal	125,887 MWh
ST-Oil	11,088 MWh
ST-Gas	- MWh
Gas	148,259 MWh
Hydro	12,225 MWh
Distillate	- MWh
Co-Gen	1,298 MWh
SPORE*	(550) MWh
EGAT*	561 MWh

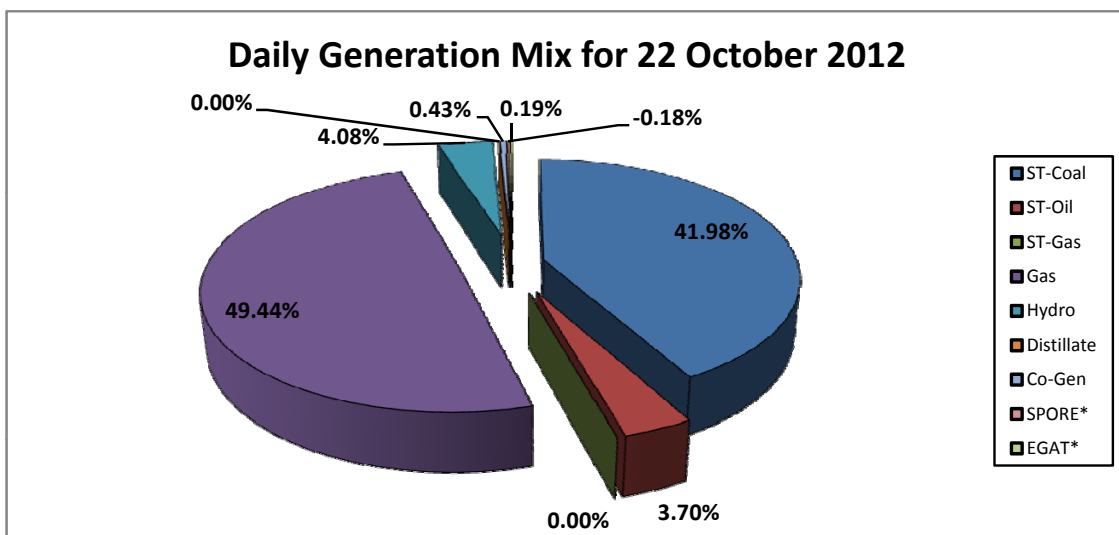

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand