

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 23 October 2012	14,935 MW	15,206 MW	1.81%	
Energy Demand for 23 October 2012	308.81 GWh	311.08 GWh	0.74%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

24-Oct-12


Daily Owners' Mix for 23 October 2012

TNB	80,131 MWh
IPP	229,407 MWh
Co-Gen	1,145 MWh
Interconnection*	(393) MWh

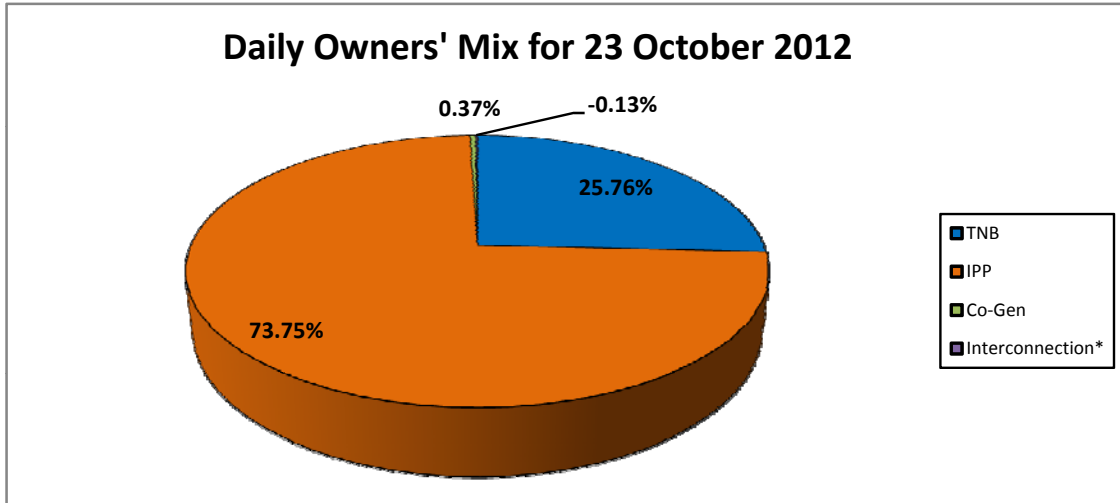

Daily Generation Mix for 23 October 2012

ST-Coal	126,989 MWh
ST-Oil	10,905 MWh
ST-Gas	- MWh
Gas	143,200 MWh
Hydro	13,824 MWh
Distillate	14,620 MWh
Co-Gen	1,145 MWh
SPORE*	(1,118) MWh
EGAT*	725 MWh

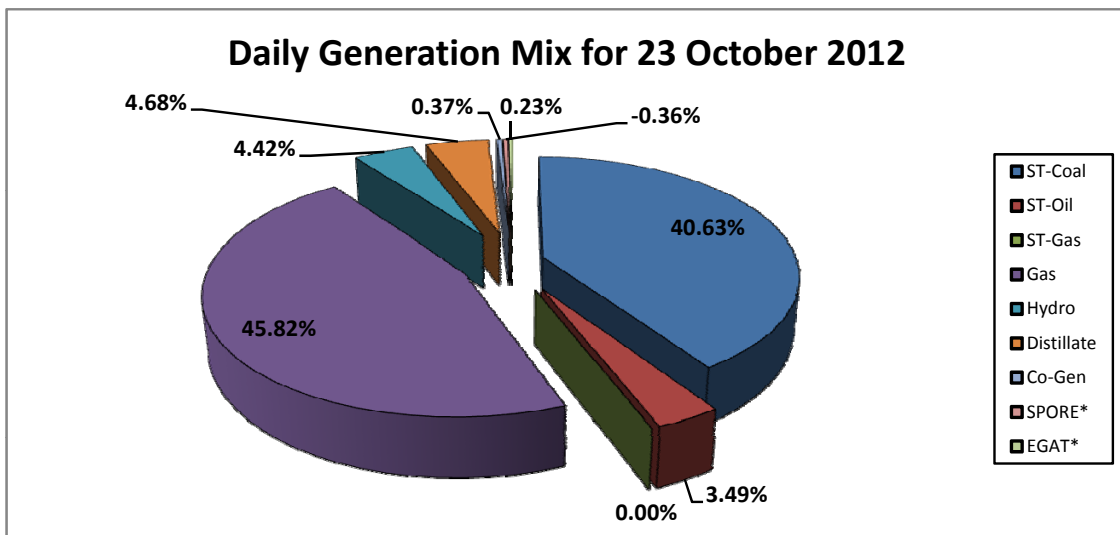

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand