

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 24 October 2012	15,065 MW	15,098 MW	0.22%	
Energy Demand for 24 October 2012	311.70 GWh	313.30 GWh	0.51%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

25-Oct-12


**Daily Owners' Mix for 24 October 2012**

TNB	81,936 MWh
IPP	230,268 MWh
Co-Gen	1,819 MWh
Interconnection*	719 MWh

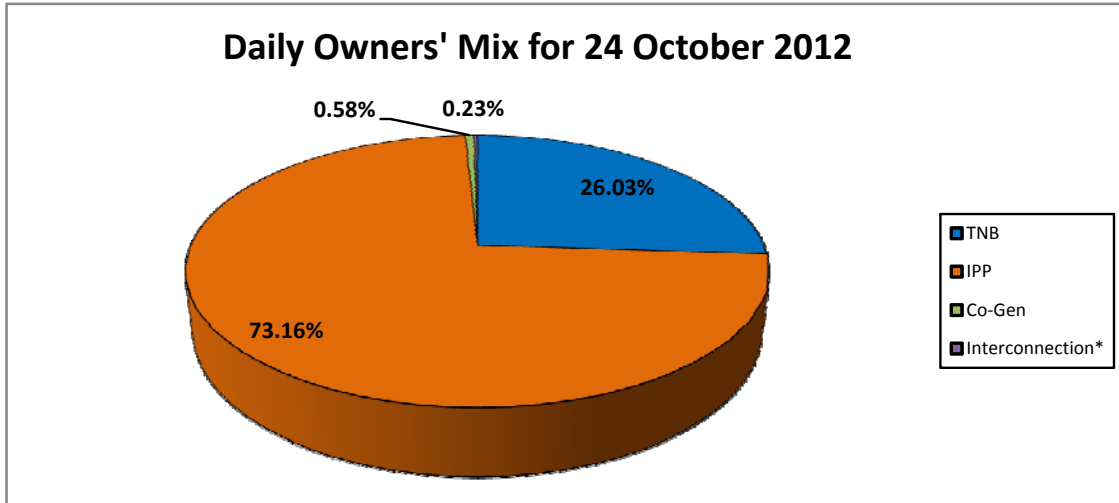

**Daily Generation Mix for 24 October 2012**

ST-Coal	127,476 MWh
ST-Oil	12,362 MWh
ST-Gas	347 MWh
Gas	133,502 MWh
Hydro	12,878 MWh
Distillate	25,639 MWh
Co-Gen	1,819 MWh
SPORE*	(6) MWh
EGAT*	725 MWh

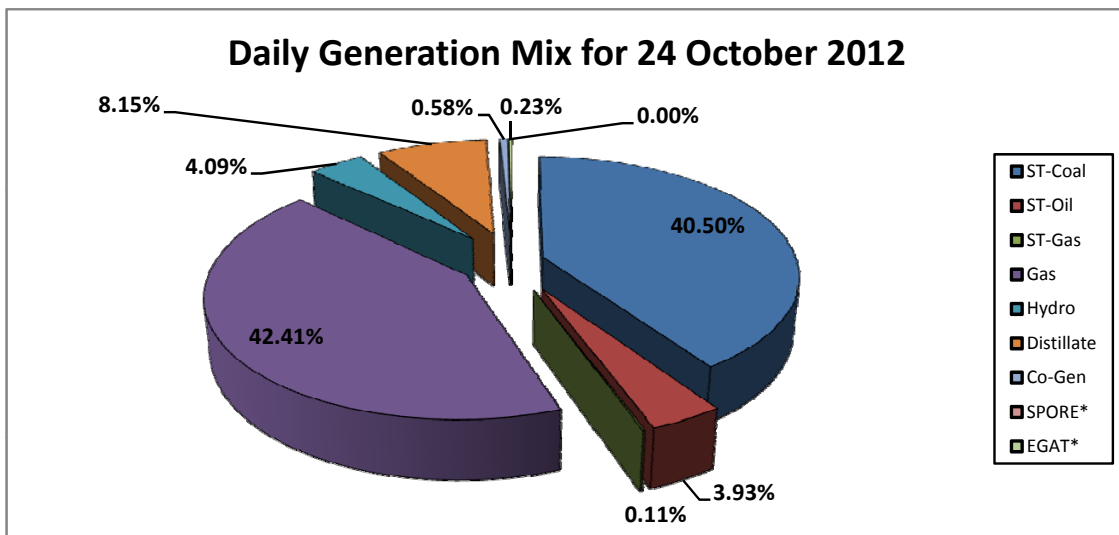

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand