

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 October 2012	14,650 MW	14,688 MW	0.26%	
Energy Demand for 25 October 2012	309.12 GWh	305.05 GWh	-1.32%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

26-Oct-12


Daily Owners' Mix for 25 October 2012

TNB	74,130 MWh
IPP	229,899 MWh
Co-Gen	1,917 MWh
Interconnection*	894 MWh

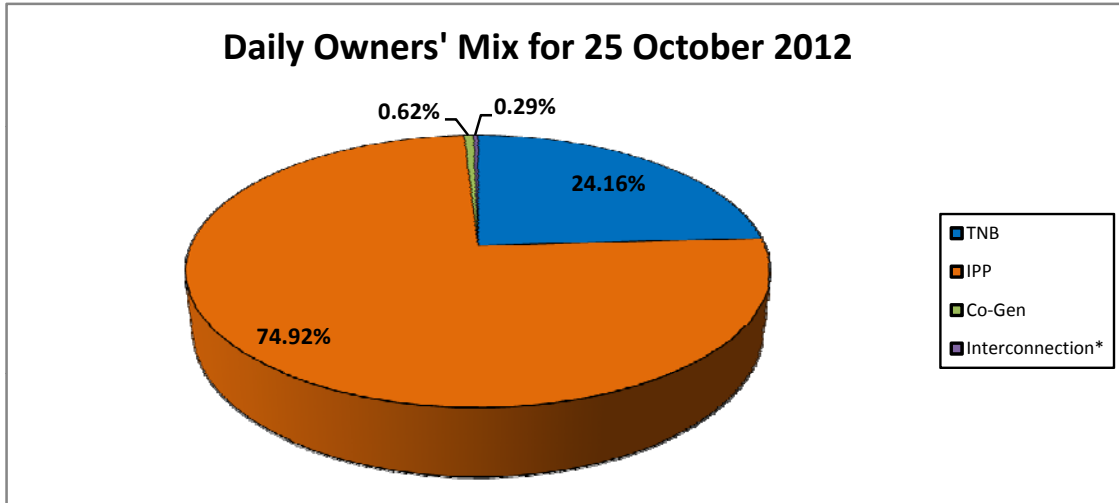

Daily Generation Mix for 25 October 2012

ST-Coal	128,102 MWh
ST-Oil	14,174 MWh
ST-Gas	- MWh
Gas	133,373 MWh
Hydro	11,250 MWh
Distillate	17,130 MWh
Co-Gen	1,917 MWh
SPORE*	172 MWh
EGAT*	722 MWh

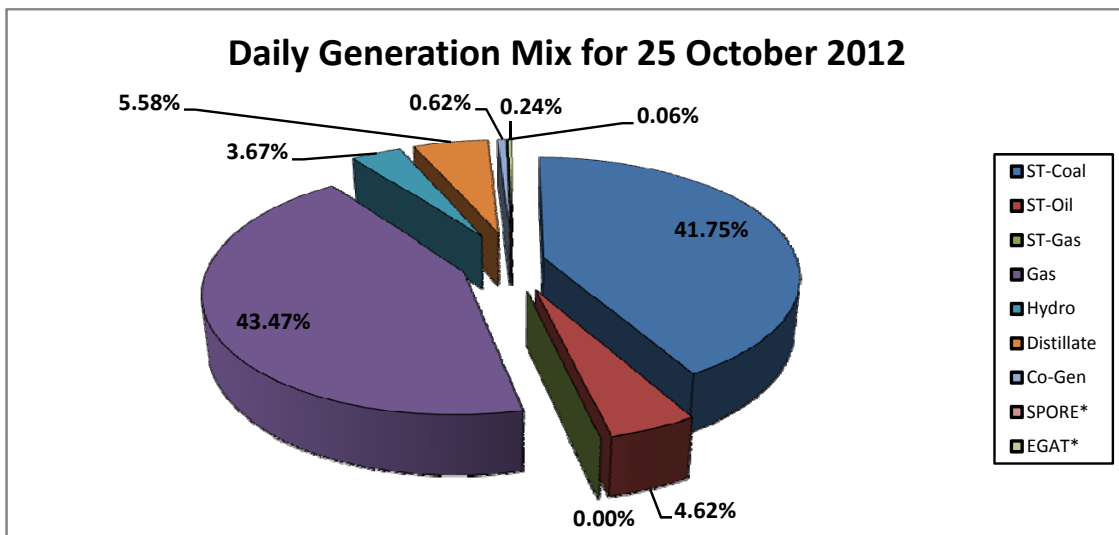

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand