


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 27 October 2012	12,367 MW	12,422 MW	0.44%	
Energy Demand for 27 October 2012	267.65 GWh	263.62 GWh	-1.51%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
28-Oct-12


Daily Owners' Mix for 27 October 2012

TNB	60,157 MWh
IPP	202,146 MWh
Co-Gen	1,873 MWh
Interconnection*	561 MWh

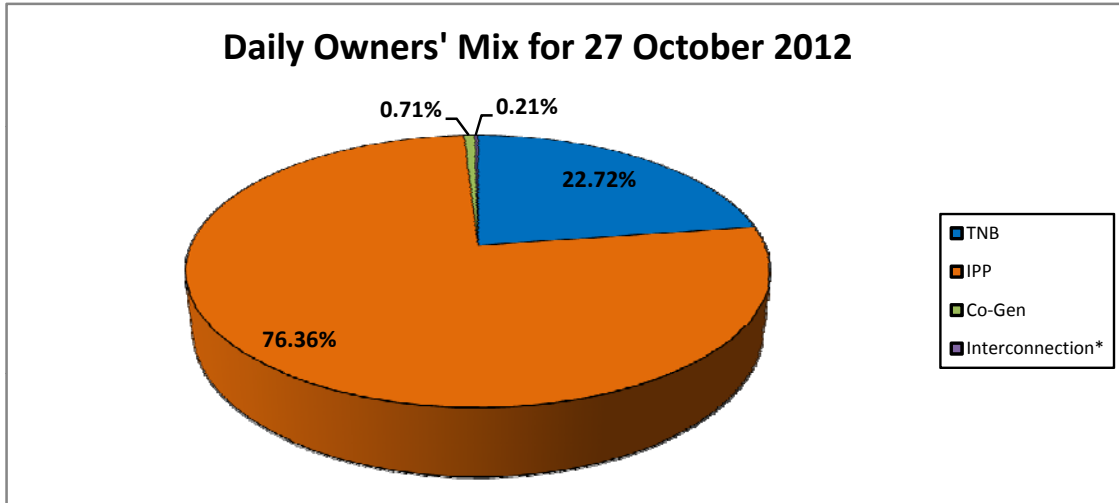

Daily Generation Mix for 27 October 2012

ST-Coal	127,553 MWh
ST-Oil	5,274 MWh
ST-Gas	- MWh
Gas	118,632 MWh
Hydro	10,844 MWh
Distillate	- MWh
Co-Gen	1,873 MWh
SPORE*	(164) MWh
EGAT*	725 MWh

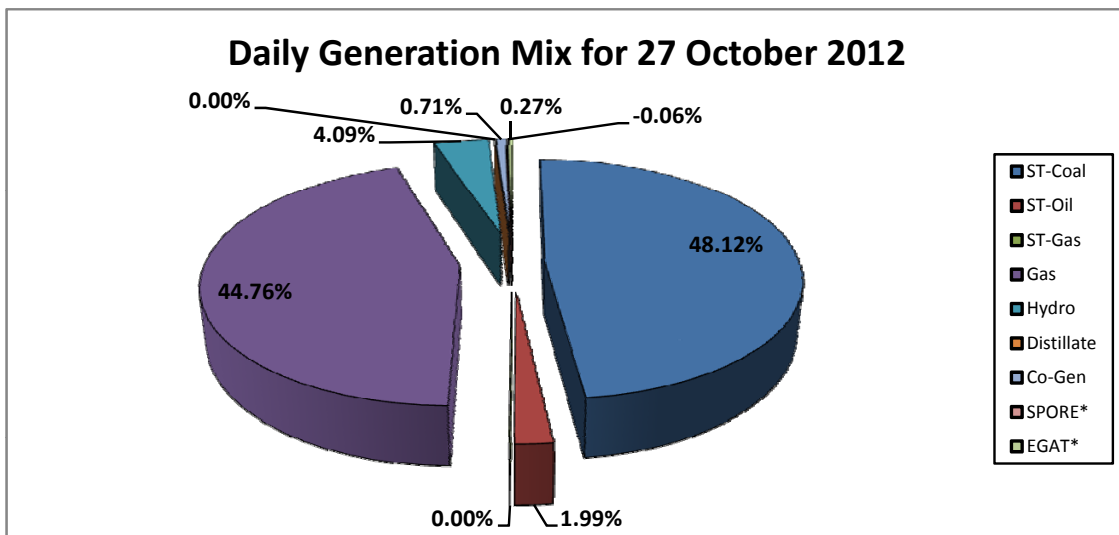

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand