

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 October 2012	12,204 MW	12,573 MW	3.02%	
Energy Demand for 28 October 2012	259.41 GWh	261.79 GWh	0.92%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

29-Oct-12


Daily Owners' Mix for 28 October 2012

TNB	57,222	MWh
IPP	203,426	MWh
Co-Gen	1,870	MWh
Interconnection*	729	MWh

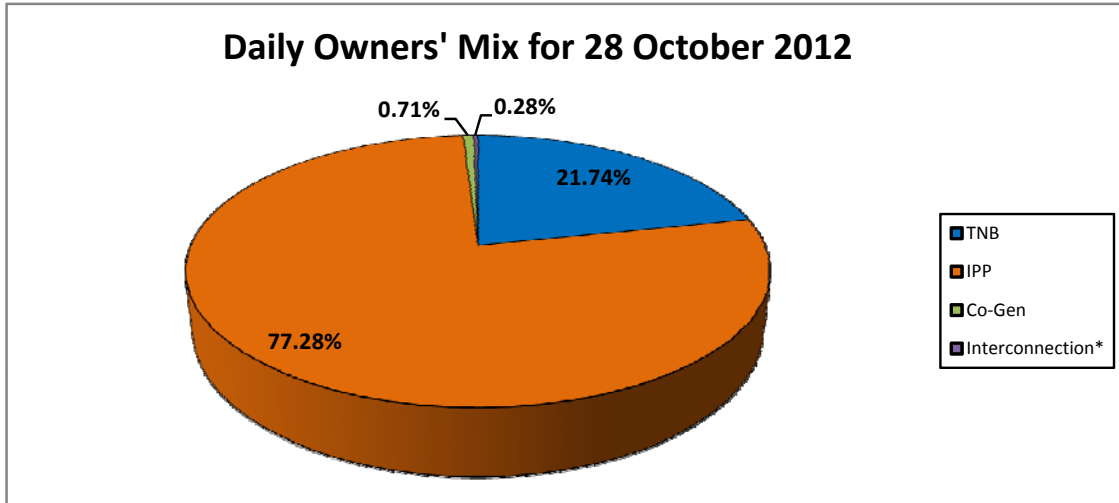

Daily Generation Mix for 28 October 2012

ST-Coal	126,892	MWh
ST-Oil	5,622	MWh
ST-Gas	-	MWh
Gas	119,438	MWh
Hydro	8,696	MWh
Distillate	-	MWh
Co-Gen	1,870	MWh
SPORE*	6	MWh
EGAT*	723	MWh

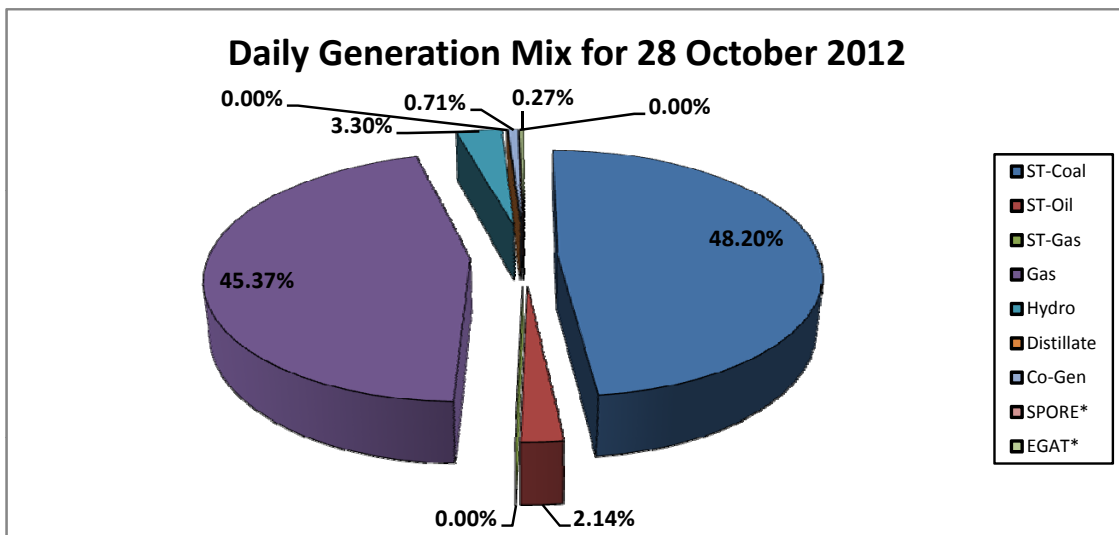

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand