

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 31 October 2012	15,314 MW	15,028 MW	-1.87%	
Energy Demand for 31 October 2012	318.90 GWh	312.24 GWh	-2.09%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

01-Nov-12


Daily Owners' Mix for 31 October 2012

TNB	81,587 MWh
IPP	227,676 MWh
Co-Gen	2,336 MWh
Interconnection*	(636) MWh

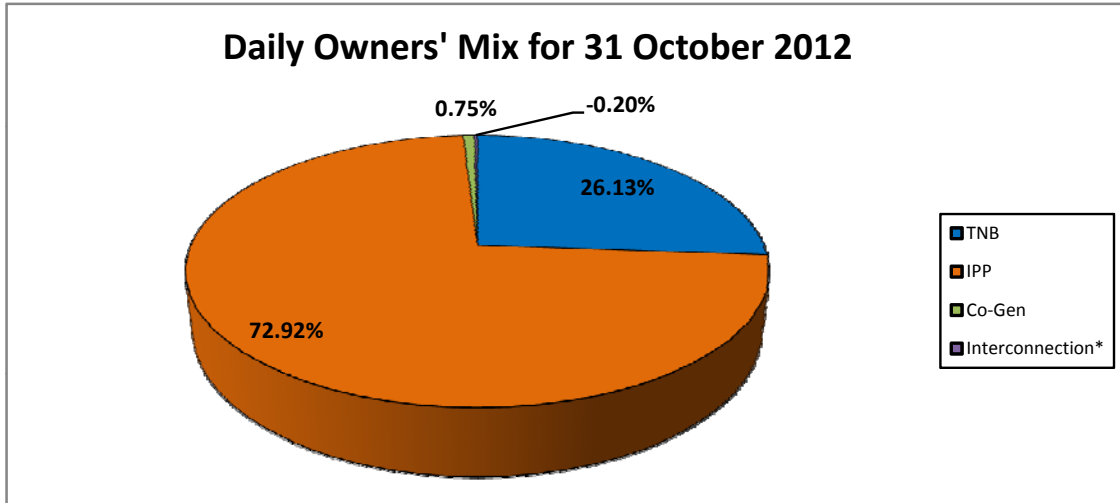

Daily Generation Mix for 31 October 2012

ST-Coal	116,881 MWh
ST-Oil	13,293 MWh
ST-Gas	- MWh
Gas	120,472 MWh
Hydro	12,558 MWh
Distillate	46,059 MWh
Co-Gen	2,336 MWh
SPORE*	58 MWh
EGAT*	(694) MWh

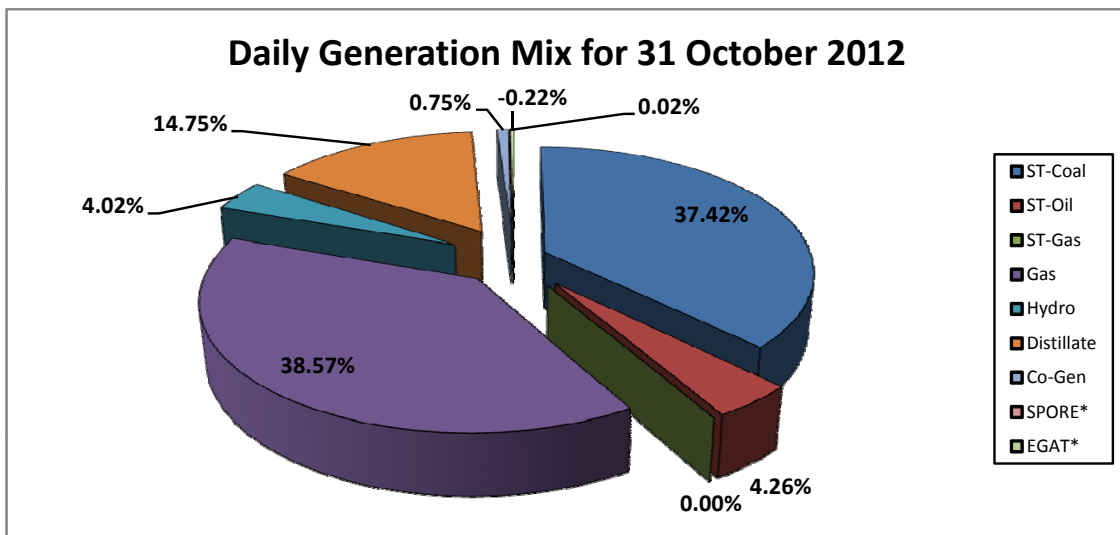

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand