

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 1 November 2012	14,771 MW	14,740 MW	-0.21%	
Energy Demand for 1 November 2012	310.79 GWh	306.02 GWh	-1.53%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

02-Nov-12


**Daily Owners' Mix for 1 November 2012**

TNB	76,638 MWh
IPP	226,657 MWh
Co-Gen	2,322 MWh
Interconnection*	(405) MWh

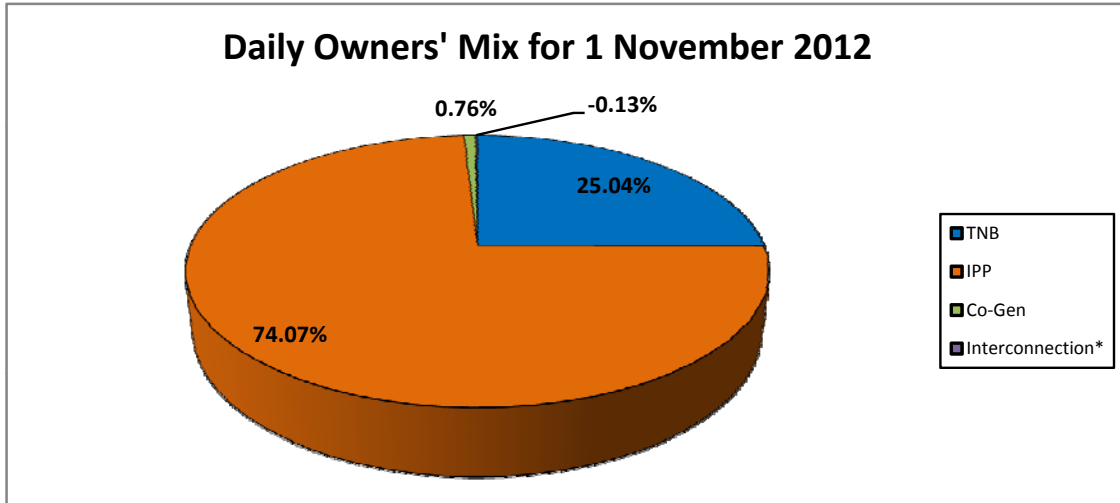

**Daily Generation Mix for 1 November 2012**

ST-Coal	125,473 MWh
ST-Oil	14,139 MWh
ST-Gas	- MWh
Gas	113,873 MWh
Hydro	13,359 MWh
Distillate	36,451 MWh
Co-Gen	2,322 MWh
SPORE*	297 MWh
EGAT*	(702) MWh

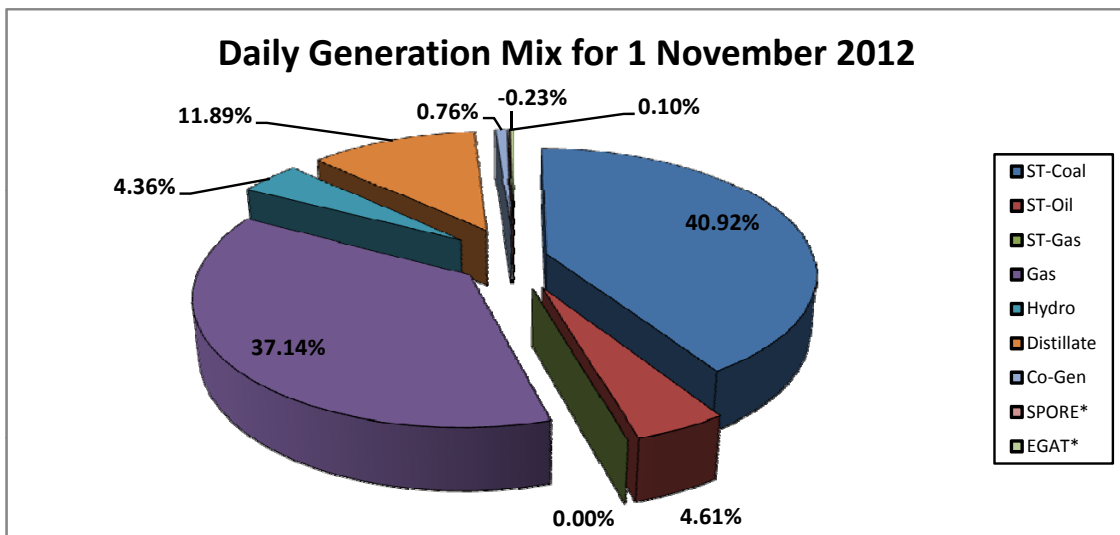

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand