

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 2 November 2012	14,625 MW	14,583 MW	-0.29%	
Energy Demand for 2 November 2012	307.85 GWh	303.18 GWh	-1.52%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

03-Nov-12


Daily Owners' Mix for 2 November 2012

TNB	70,760 MWh
IPP	229,648 MWh
Co-Gen	2,328 MWh
Interconnection*	(448) MWh

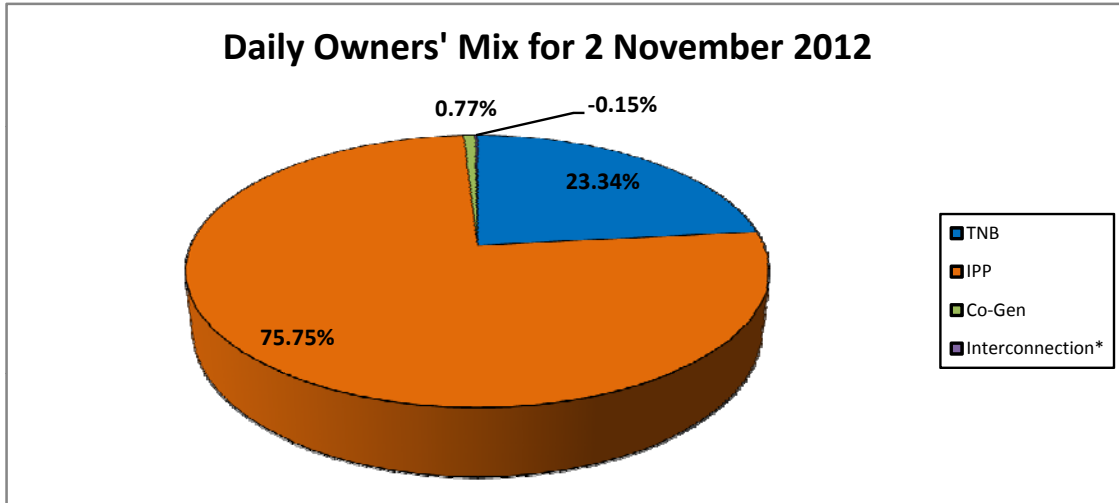

Daily Generation Mix for 2 November 2012

ST-Coal	132,497 MWh
ST-Oil	13,948 MWh
ST-Gas	- MWh
Gas	105,907 MWh
Hydro	11,387 MWh
Distillate	36,669 MWh
Co-Gen	2,328 MWh
SPORE*	249 MWh
EGAT*	(697) MWh

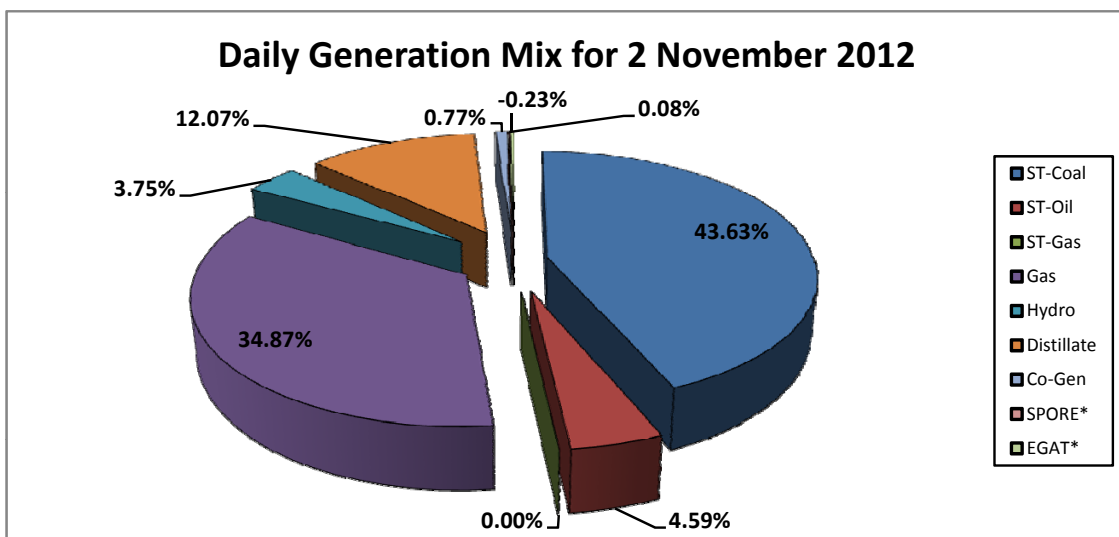

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand