

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 November 2012	13,037 MW	12,994 MW	-0.33%	
Energy Demand for 3 November 2012	284.98 GWh	281.87 GWh	-1.09%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Nov-12


Daily Owners' Mix for 3 November 2012

TNB	61,128 MWh
IPP	217,431 MWh
Co-Gen	2,325 MWh
Interconnection*	(987) MWh

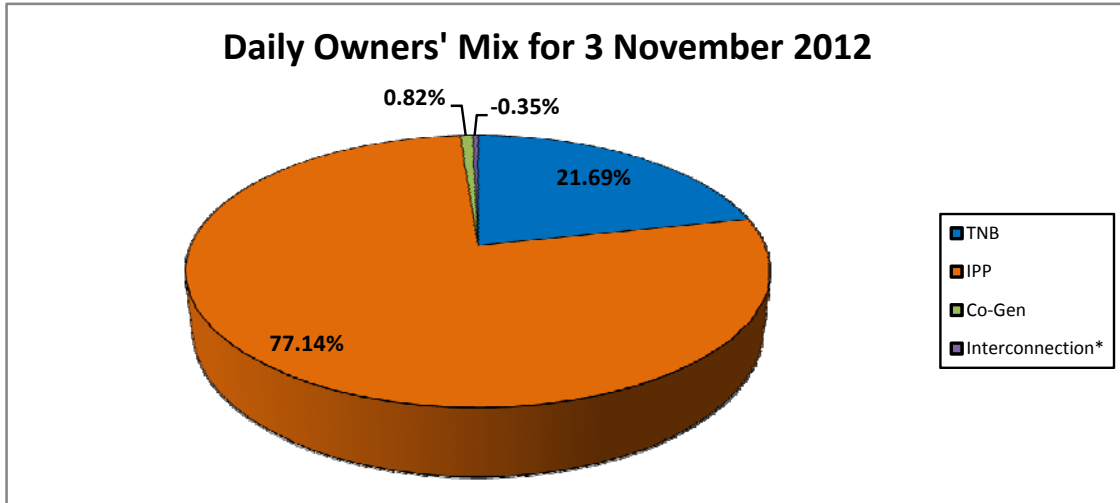

Daily Generation Mix for 3 November 2012

ST-Coal	133,337 MWh
ST-Oil	13,676 MWh
ST-Gas	- MWh
Gas	88,508 MWh
Hydro	12,983 MWh
Distillate	30,055 MWh
Co-Gen	2,325 MWh
SPORE*	(290) MWh
EGAT*	(697) MWh

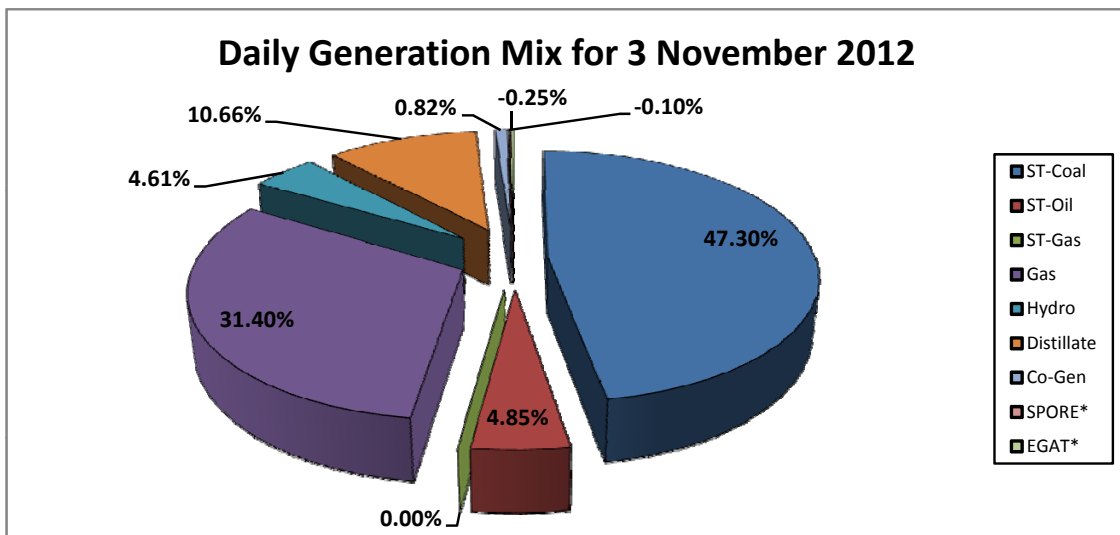

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand