

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 7 November 2012	14,707 MW	15,080 MW	2.54%	
Energy Demand for 7 November 2012	304.25 GWh	307.31 GWh	1.01%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

08-Nov-12


Daily Owners' Mix for 7 November 2012

TNB	60,058 MWh
IPP	246,748 MWh
Co-Gen	1,449 MWh
Interconnection*	948 MWh

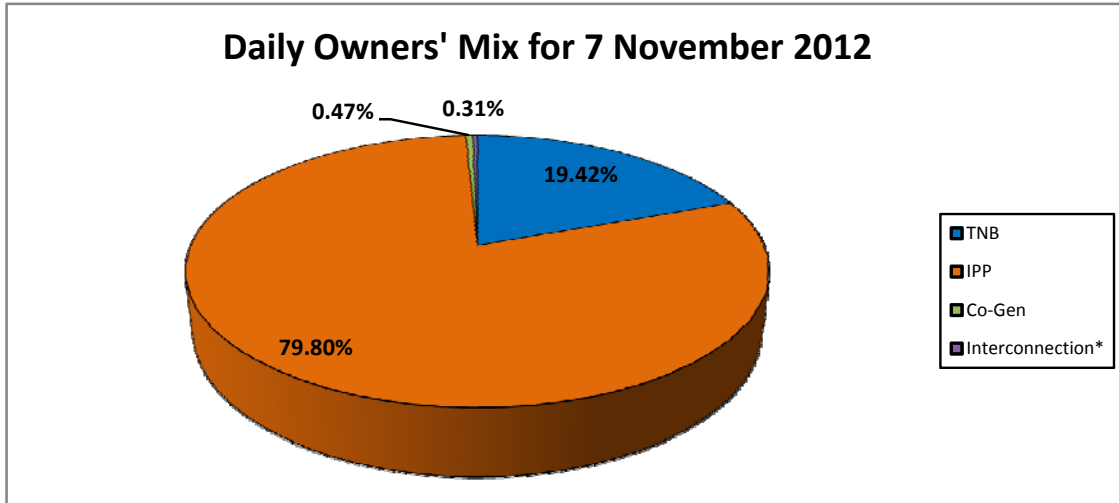

Daily Generation Mix for 7 November 2012

ST-Coal	142,738 MWh
ST-Oil	11,874 MWh
ST-Gas	- MWh
Gas	138,939 MWh
Hydro	13,246 MWh
Distillate	9 MWh
Co-Gen	1,449 MWh
SPORE*	226 MWh
EGAT*	722 MWh

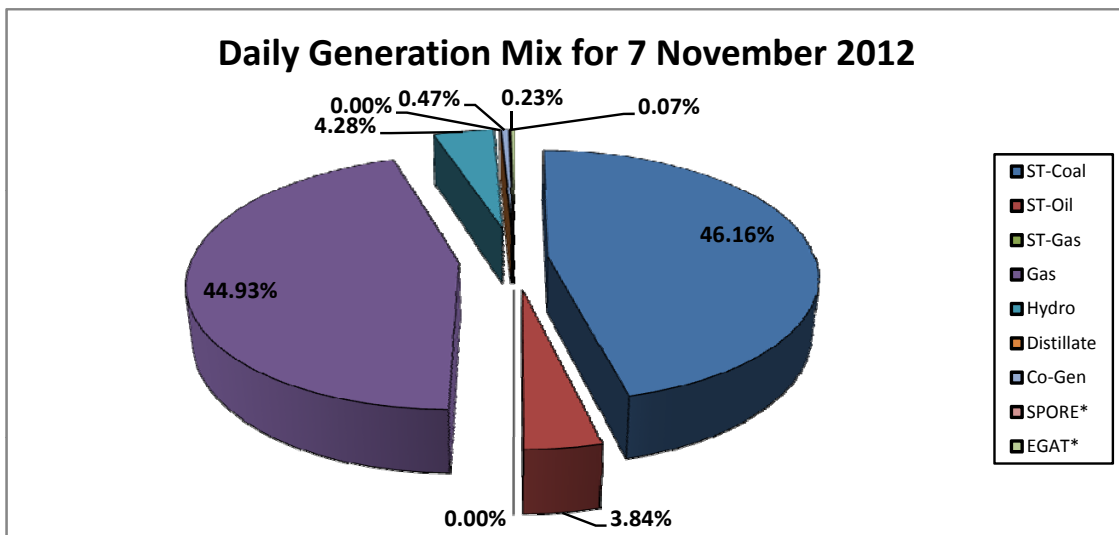

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand