


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 8 November 2012	14,953 MW	14,880 MW	-0.49%	
Energy Demand for 8 November 2012	308.82 GWh	308.52 GWh	-0.10%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
09-Nov-12


Daily Owners' Mix for 8 November 2012

TNB	63,232 MWh
IPP	243,542 MWh
Co-Gen	1,423 MWh
Interconnection*	(330) MWh

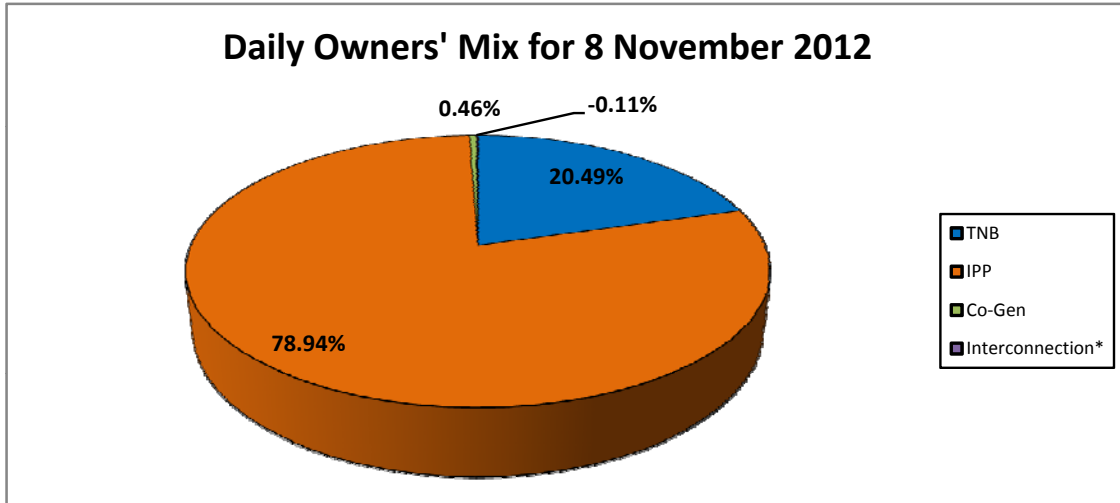

Daily Generation Mix for 8 November 2012

ST-Coal	142,458 MWh
ST-Oil	6,049 MWh
ST-Gas	- MWh
Gas	142,271 MWh
Hydro	11,208 MWh
Distillate	4,788 MWh
Co-Gen	1,423 MWh
SPORE*	(1,052) MWh
EGAT*	722 MWh

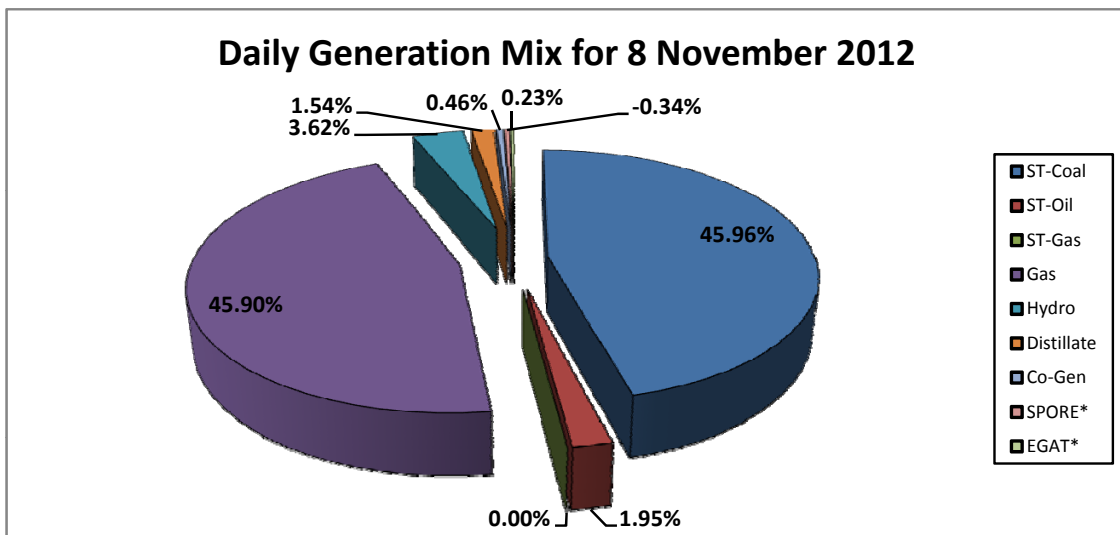

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand