

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 9 November 2012	14,513 MW	14,557 MW	0.30%	
Energy Demand for 9 November 2012	305.45 GWh	296.92 GWh	-2.79%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

10-Nov-12


**Daily Owners' Mix for 9 November 2012**

TNB	60,893 MWh
IPP	240,294 MWh
Co-Gen	1,386 MWh
Interconnection*	373 MWh

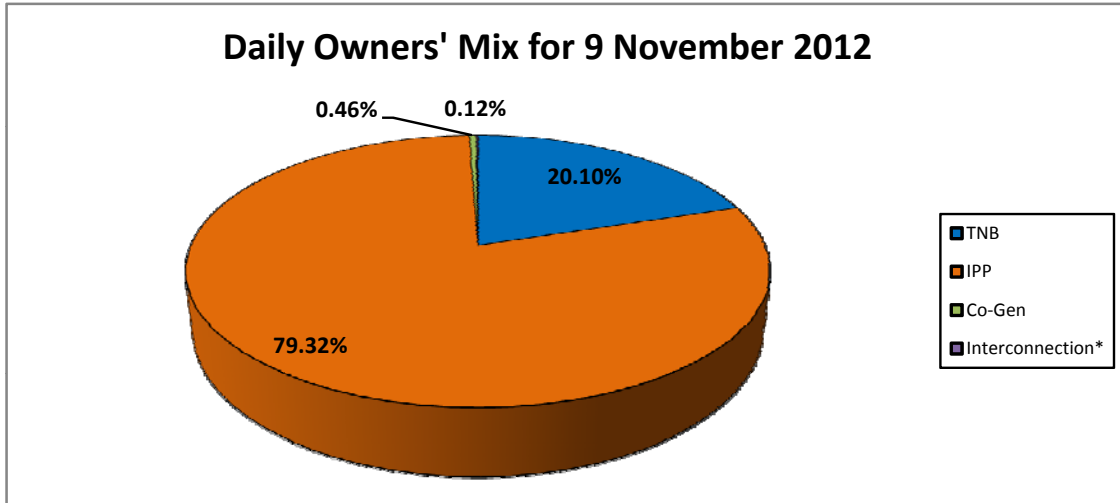

**Daily Generation Mix for 9 November 2012**

ST-Coal	144,305 MWh
ST-Oil	6,679 MWh
ST-Gas	- MWh
Gas	128,617 MWh
Hydro	11,170 MWh
Distillate	10,416 MWh
Co-Gen	1,386 MWh
SPORE*	270 MWh
EGAT*	103 MWh

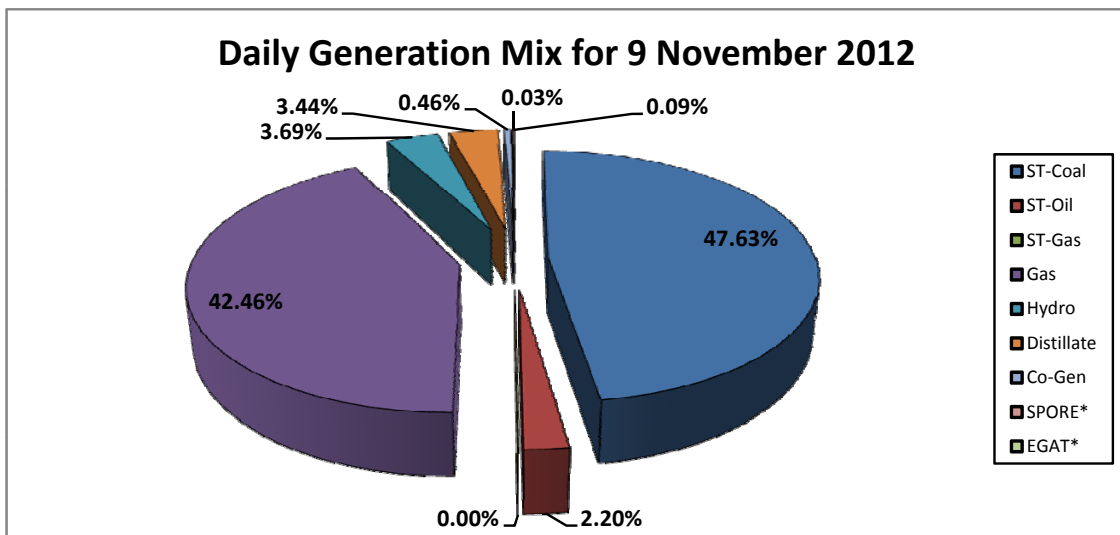

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand