

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 12 November 2012	14,511 MW	14,291 MW	-1.52%	
Energy Demand for 12 November 2012	295.13 GWh	289.60 GWh	-1.87%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

13-Nov-12


Daily Owners' Mix for 12 November 2012

TNB	65,509 MWh
IPP	221,915 MWh
Co-Gen	1,381 MWh
Interconnection*	(794) MWh

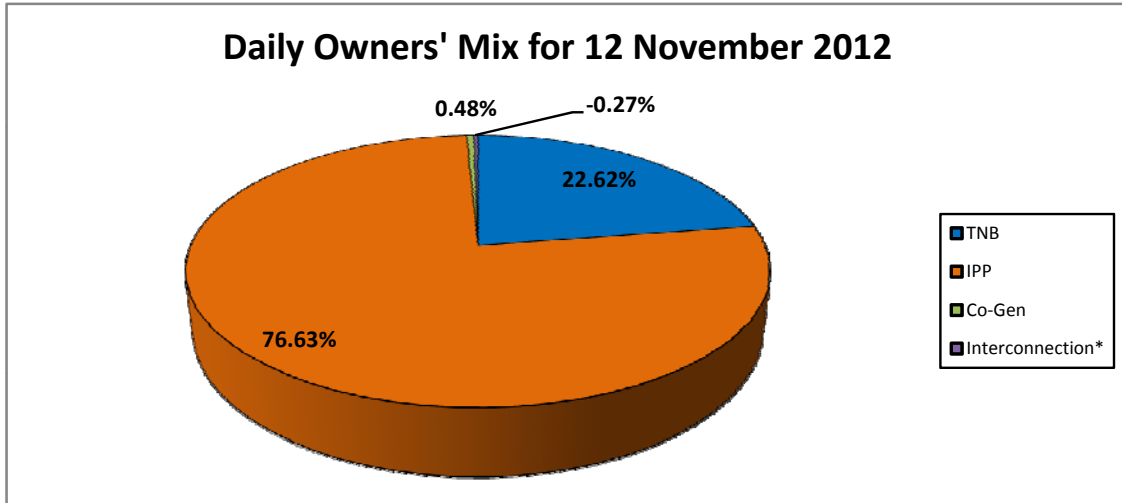

Daily Generation Mix for 12 November 2012

ST-Coal	125,632 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	148,226 MWh
Hydro	13,566 MWh
Distillate	- MWh
Co-Gen	1,381 MWh
SPORE*	(98) MWh
EGAT*	(696) MWh

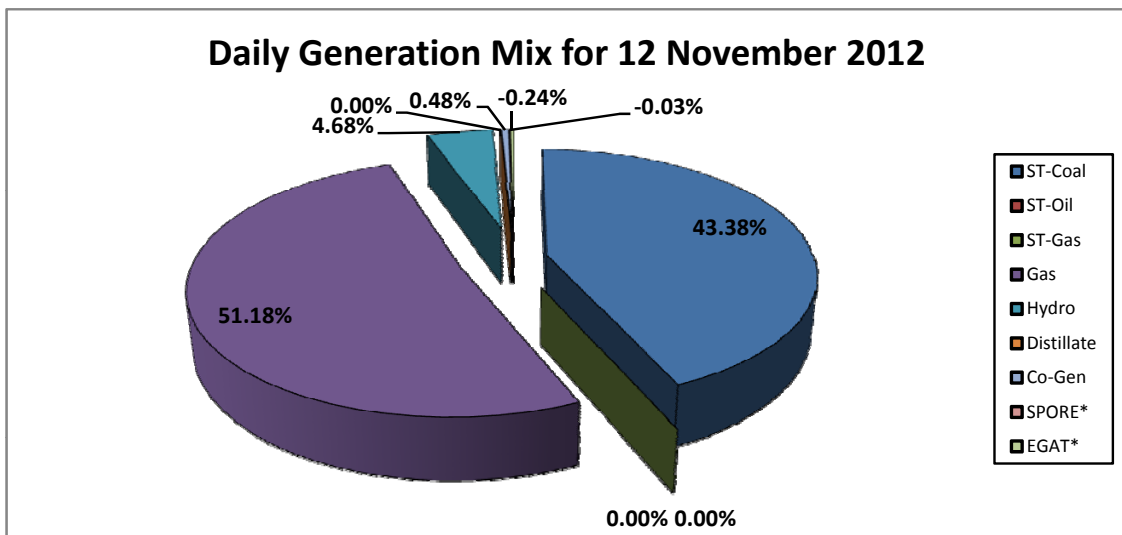

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand