

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 15 November 2012	12,873 MW	13,217 MW	2.67%	
Energy Demand for 15 November 2012	270.29 GWh	277.72 GWh	2.75%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

16-Nov-12


Daily Owners' Mix for 15 November 2012

TNB	70,197 MWh
IPP	205,330 MWh
Co-Gen	1,314 MWh
Interconnection*	(881) MWh

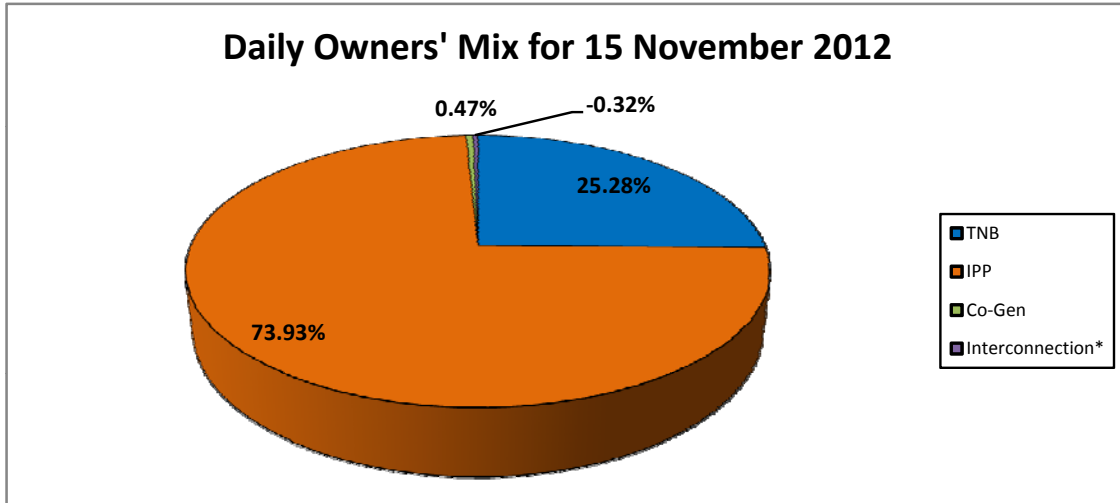

Daily Generation Mix for 15 November 2012

ST-Coal	126,735 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	138,566 MWh
Hydro	10,226 MWh
Distillate	- MWh
Co-Gen	1,314 MWh
SPORE*	(183) MWh
EGAT*	(698) MWh

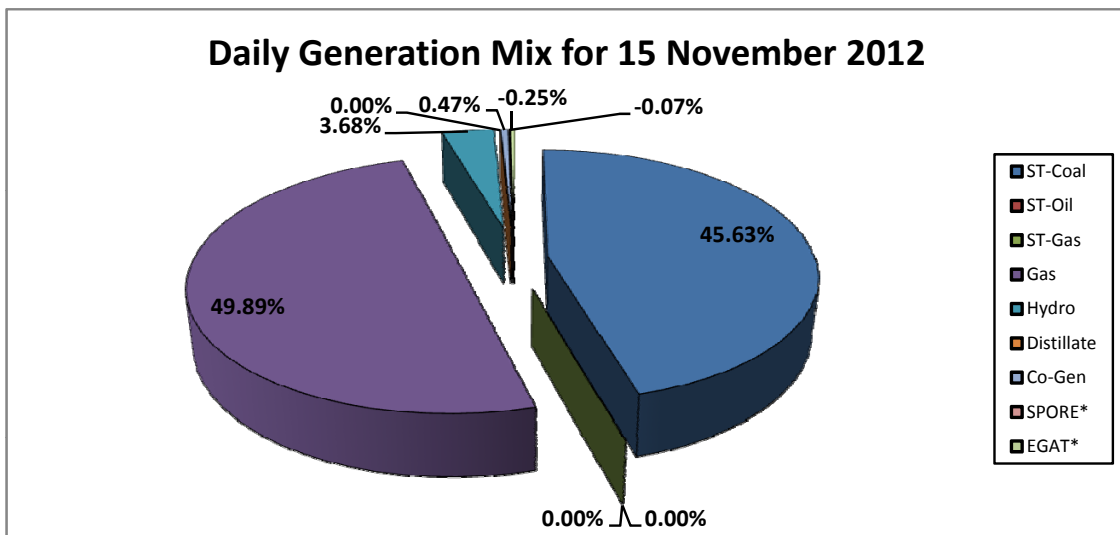

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand