

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 18 November 2012	12,276 MW	12,493 MW	1.77%	
Energy Demand for 18 November 2012	260.72 GWh	267.75 GWh	2.70%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

19-Nov-12


Daily Owners' Mix for 18 November 2012

TNB	50,650 MWh
IPP	214,791 MWh
Co-Gen	1,548 MWh
Interconnection*	(765) MWh

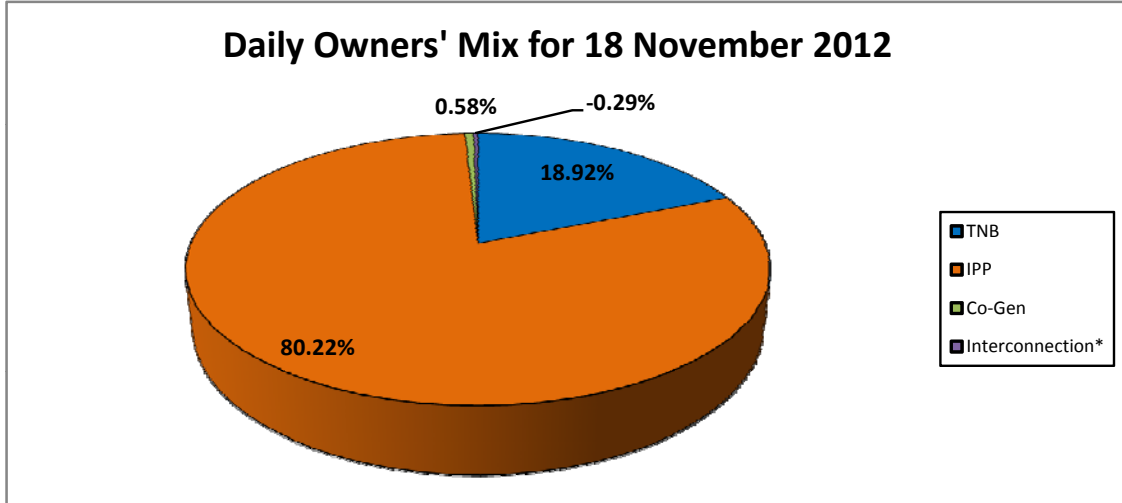

Daily Generation Mix for 18 November 2012

ST-Coal	127,353 MWh
ST-Oil	6,692 MWh
ST-Gas	- MWh
Gas	104,399 MWh
Hydro	9,778 MWh
Distillate	17,219 MWh
Co-Gen	1,548 MWh
SPORE*	(67) MWh
EGAT*	(698) MWh

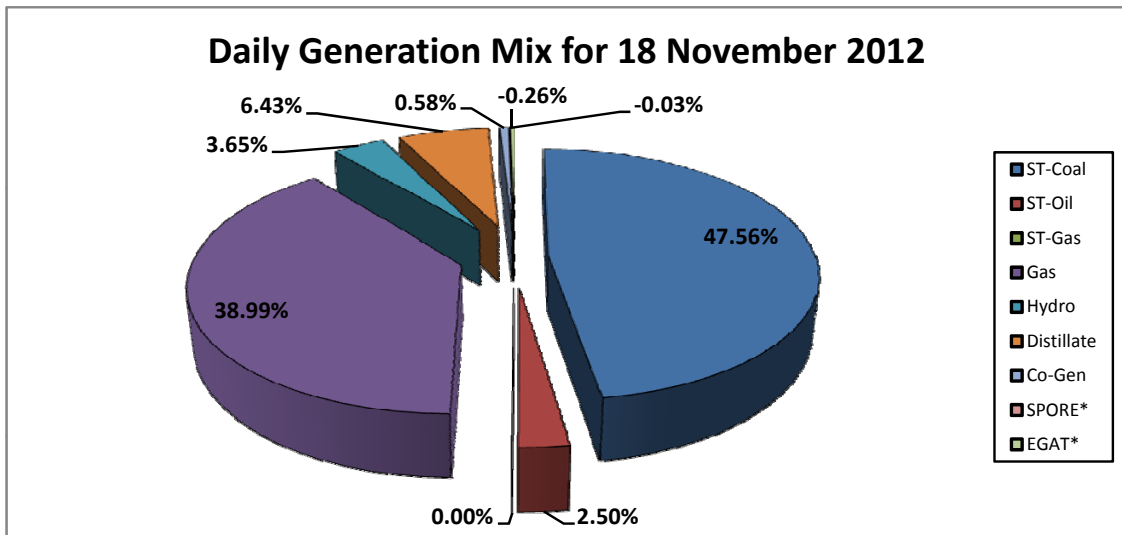

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand