


GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 19 November 2012	14,594 MW	14,488 MW	-0.73%	
Energy Demand for 19 November 2012	304.37 GWh	300.71 GWh	-1.20%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:
Electricity Market Operations
Electricity Supply & Market Regulations Dept.
Energy Commission Malaysia
20-Nov-12


Daily Owners' Mix for 19 November 2012

TNB	67,616 MWh
IPP	232,362 MWh
Co-Gen	1,566 MWh
Interconnection*	838 MWh

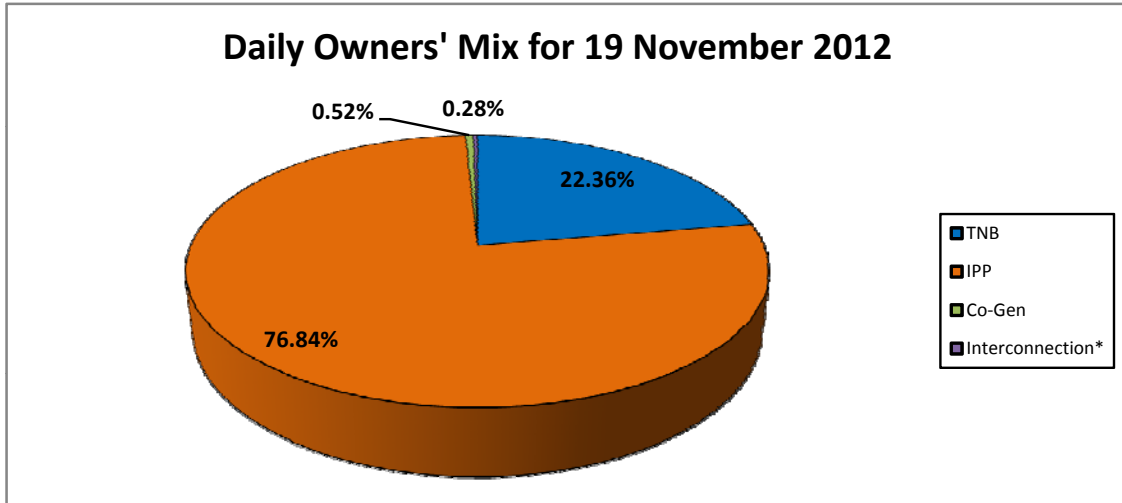

Daily Generation Mix for 19 November 2012

ST-Coal	126,750 MWh
ST-Oil	6,706 MWh
ST-Gas	- MWh
Gas	128,380 MWh
Hydro	15,174 MWh
Distillate	22,968 MWh
Co-Gen	1,566 MWh
SPORE*	199 MWh
EGAT*	639 MWh

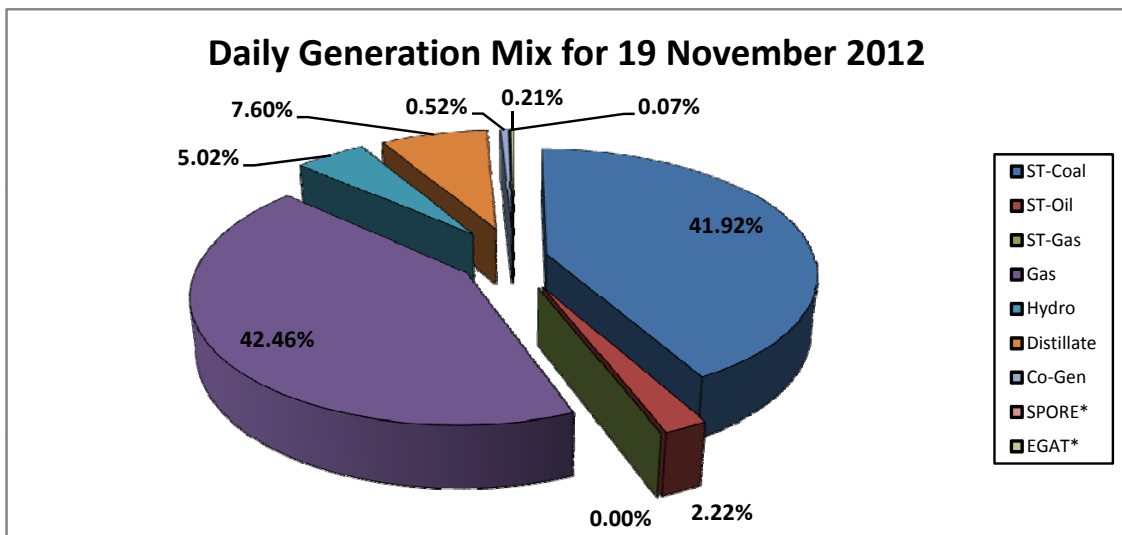

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand