

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 24 November 2012	13,013 MW	12,978 MW	-0.27%	
Energy Demand for 24 November 2012	285.52 GWh	280.55 GWh	-1.74%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

25-Nov-12


Daily Owners' Mix for 24 November 2012

TNB	60,278 MWh
IPP	219,554 MWh
Co-Gen	1,525 MWh
Interconnection*	811 MWh

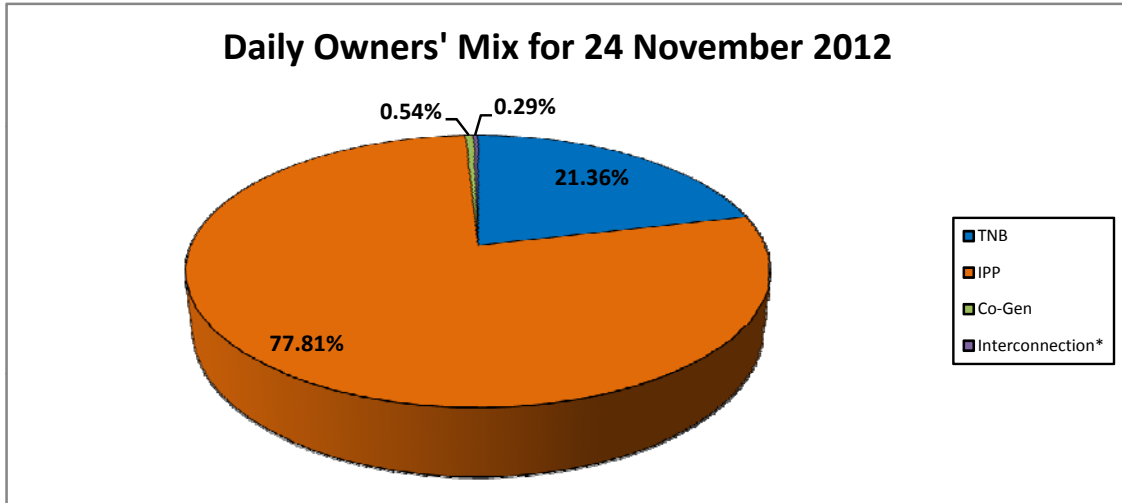

Daily Generation Mix for 24 November 2012

ST-Coal	138,251 MWh
ST-Oil	- MWh
ST-Gas	63 MWh
Gas	134,401 MWh
Hydro	7,117 MWh
Distillate	- MWh
Co-Gen	1,525 MWh
SPORE*	79 MWh
EGAT*	732 MWh

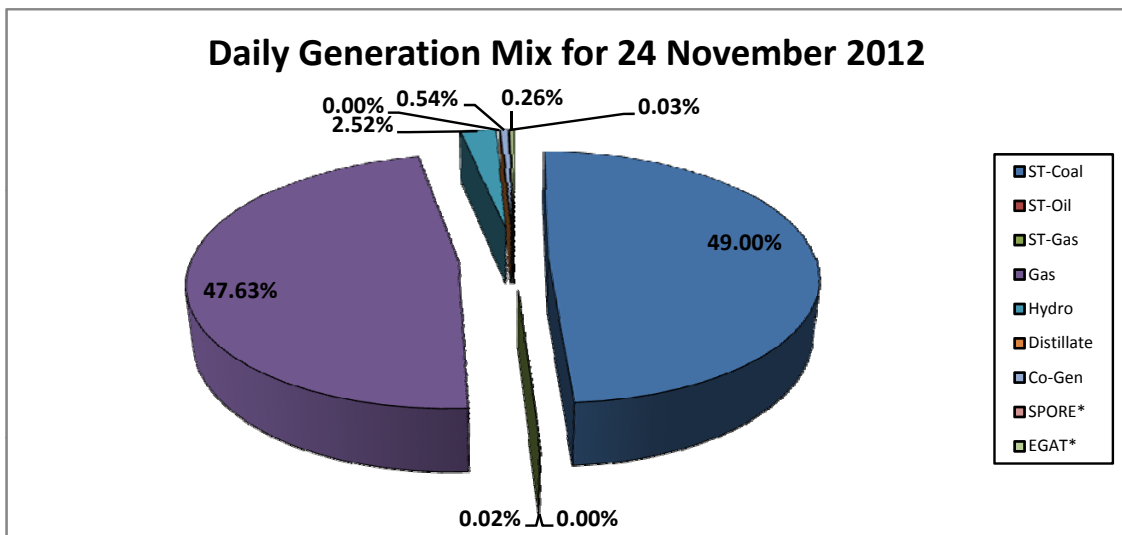

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand