

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 25 November 2012	12,381 MW	12,439 MW	0.47%	
Energy Demand for 25 November 2012	264.25 GWh	264.61 GWh	0.14%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

26-Nov-12


Daily Owners' Mix for 25 November 2012

TNB	56,687 MWh
IPP	206,851 MWh
Co-Gen	1,440 MWh
Interconnection*	371 MWh

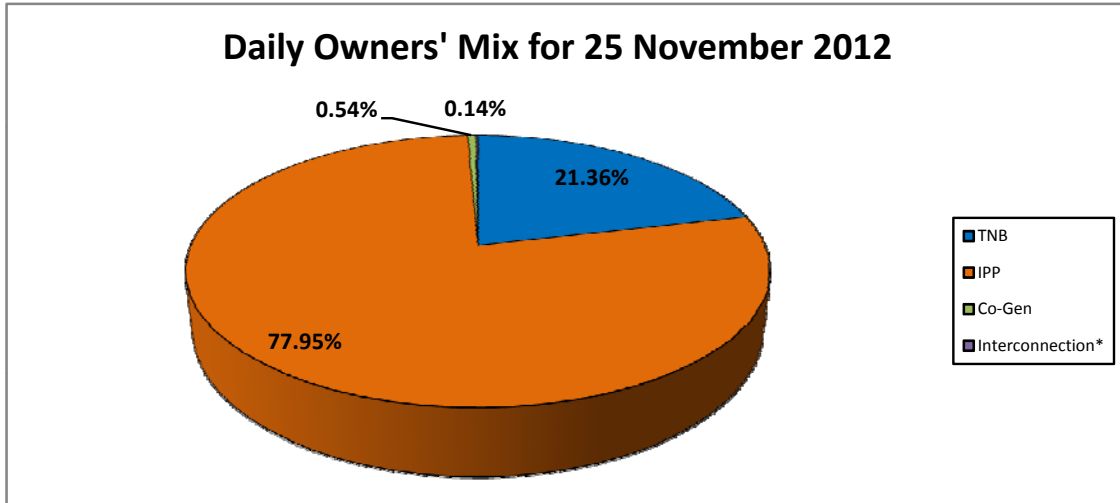

Daily Generation Mix for 25 November 2012

ST-Coal	135,948 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	119,275 MWh
Hydro	8,315 MWh
Distillate	- MWh
Co-Gen	1,440 MWh
SPORE*	(348) MWh
EGAT*	719 MWh

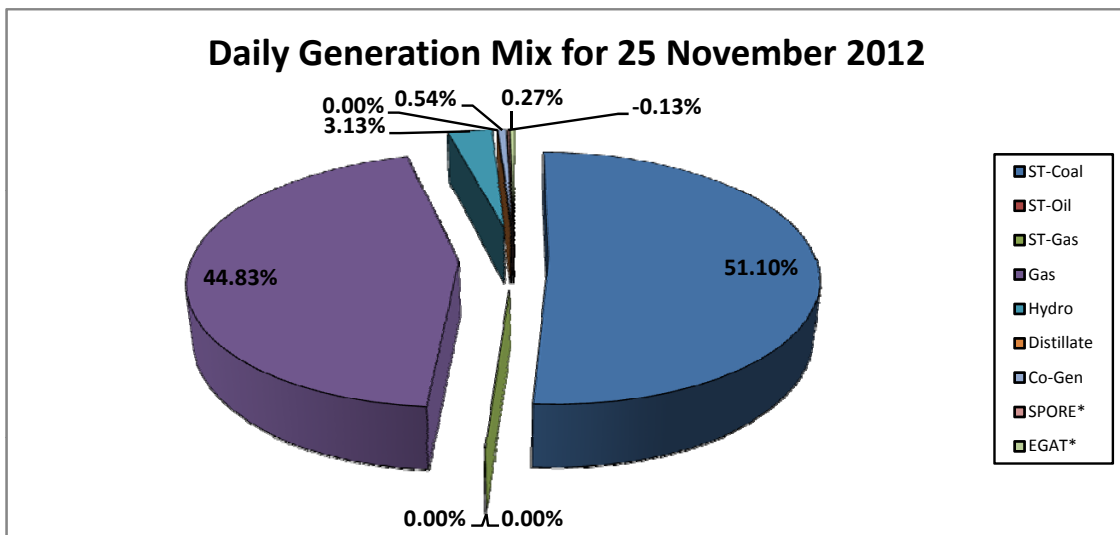

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand