

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 November 2012	15,053 MW	15,163 MW	0.73%	
Energy Demand for 28 November 2012	311.47 GWh	310.47 GWh	-0.32%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

29-Nov-12


Daily Owners' Mix for 28 November 2012

TNB	79,087 MWh
IPP	229,347 MWh
Co-Gen	1,298 MWh
Interconnection*	(739) MWh

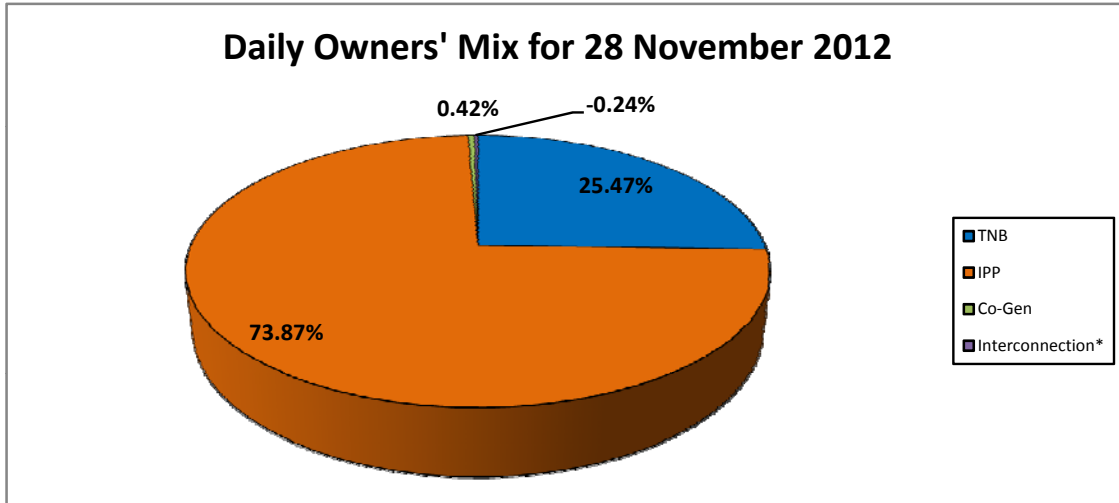

Daily Generation Mix for 28 November 2012

ST-Coal	127,324 MWh
ST-Oil	6,693 MWh
ST-Gas	531 MWh
Gas	129,611 MWh
Hydro	12,669 MWh
Distillate	31,606 MWh
Co-Gen	1,298 MWh
SPORE*	(41) MWh
EGAT*	(698) MWh

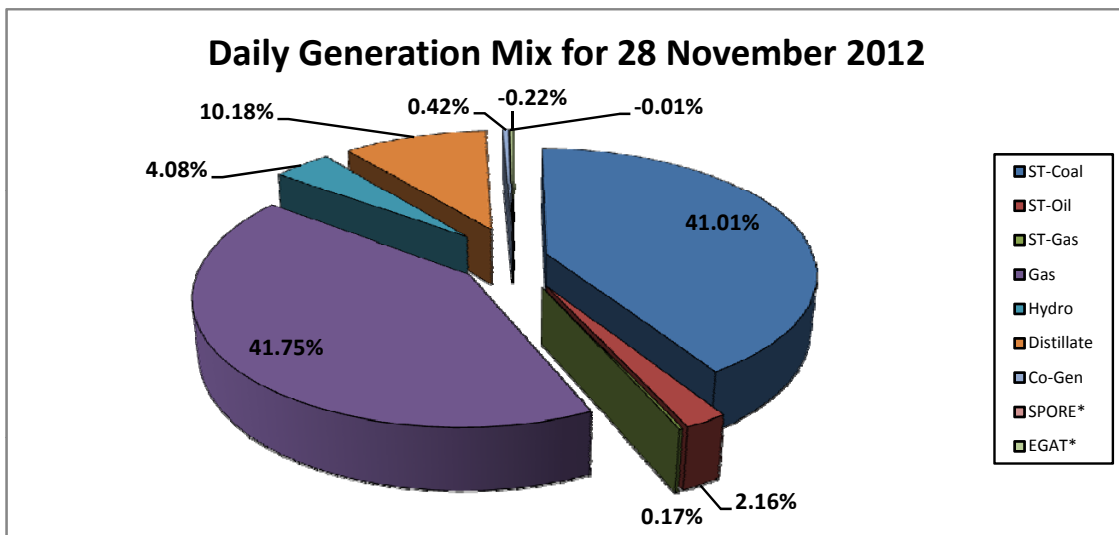

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand