

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 29 November 2012	15,078 MW	15,075 MW	-0.02%	
Energy Demand for 29 November 2012	311.39 GWh	309.86 GWh	-0.49%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

30-Nov-12


Daily Owners' Mix for 29 November 2012

TNB	72,278 MWh
IPP	235,364 MWh
Co-Gen	1,081 MWh
Interconnection*	(1,133) MWh

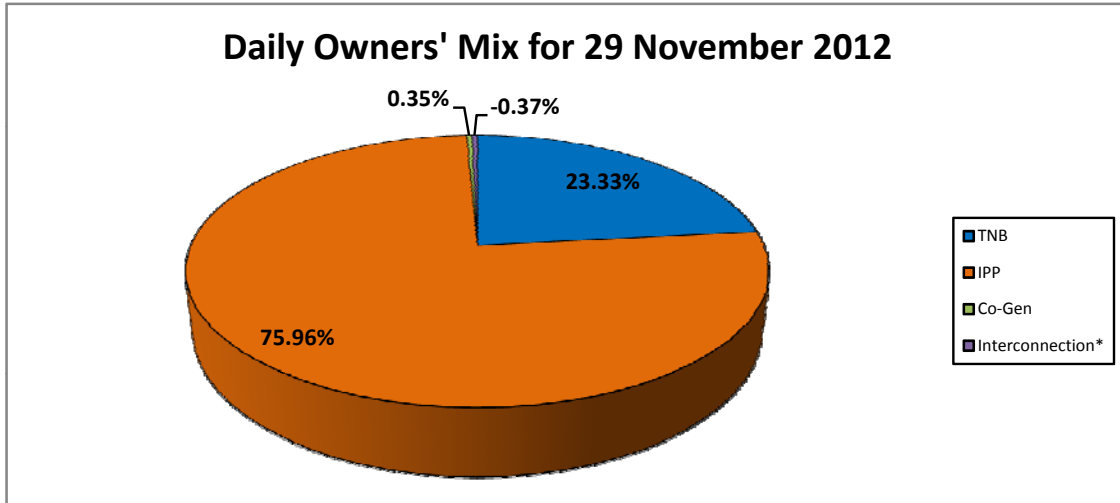

Daily Generation Mix for 29 November 2012

ST-Coal	131,676 MWh
ST-Oil	6,697 MWh
ST-Gas	- MWh
Gas	139,312 MWh
Hydro	10,087 MWh
Distillate	19,870 MWh
Co-Gen	1,081 MWh
SPORE*	(436) MWh
EGAT*	(697) MWh

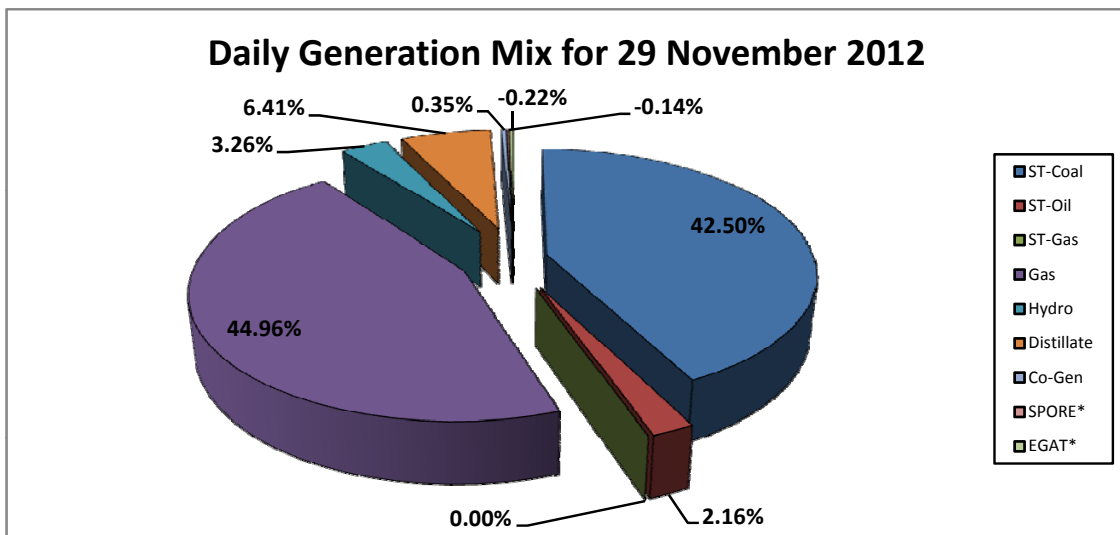

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand