

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 30 November 2012	14,758 MW	14,606 MW	-1.03%	
Energy Demand for 30 November 2012	307.56 GWh	304.68 GWh	-0.94%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

01-Dec-12


Daily Owners' Mix for 30 November 2012

TNB	70,220 MWh
IPP	233,233 MWh
Co-Gen	1,012 MWh
Interconnection*	(218) MWh

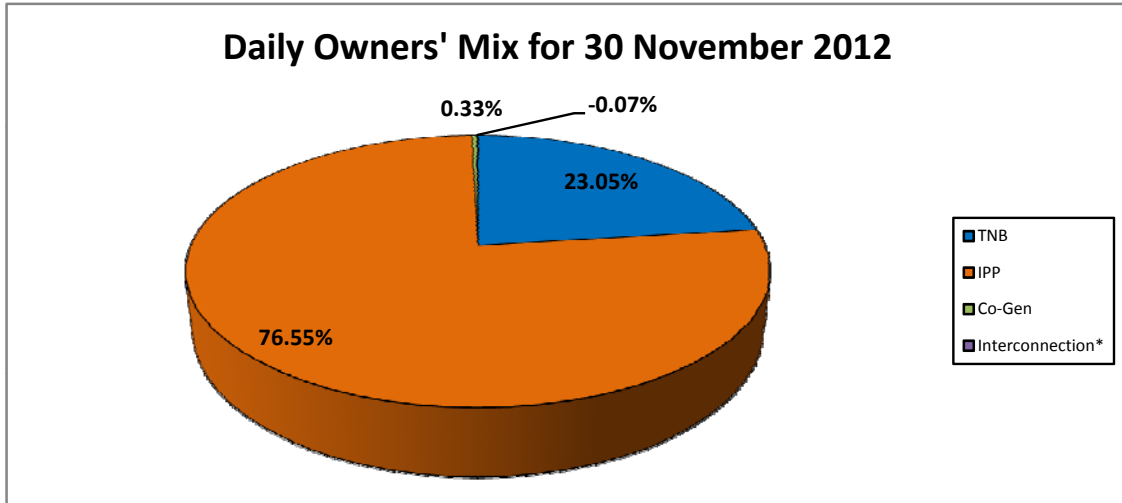

Daily Generation Mix for 30 November 2012

ST-Coal	134,095 MWh
ST-Oil	4,955 MWh
ST-Gas	- MWh
Gas	154,659 MWh
Hydro	8,294 MWh
Distillate	1,450 MWh
Co-Gen	1,012 MWh
SPORE*	480 MWh
EGAT*	(698) MWh

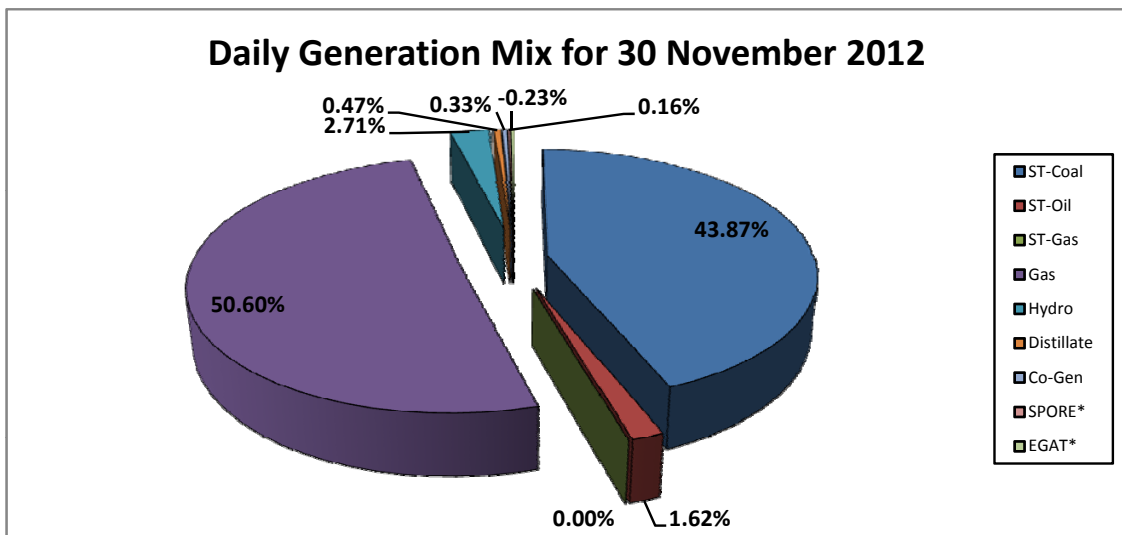

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand