

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 3 December 2012	14,753 MW	14,643 MW	-0.75%	
Energy Demand for 3 December 2012	299.39 GWh	297.62 GWh	-0.59%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Dec-12


Daily Owners' Mix for 3 December 2012

TNB	68,647 MWh
IPP	227,657 MWh
Co-Gen	2,116 MWh
Interconnection*	804 MWh

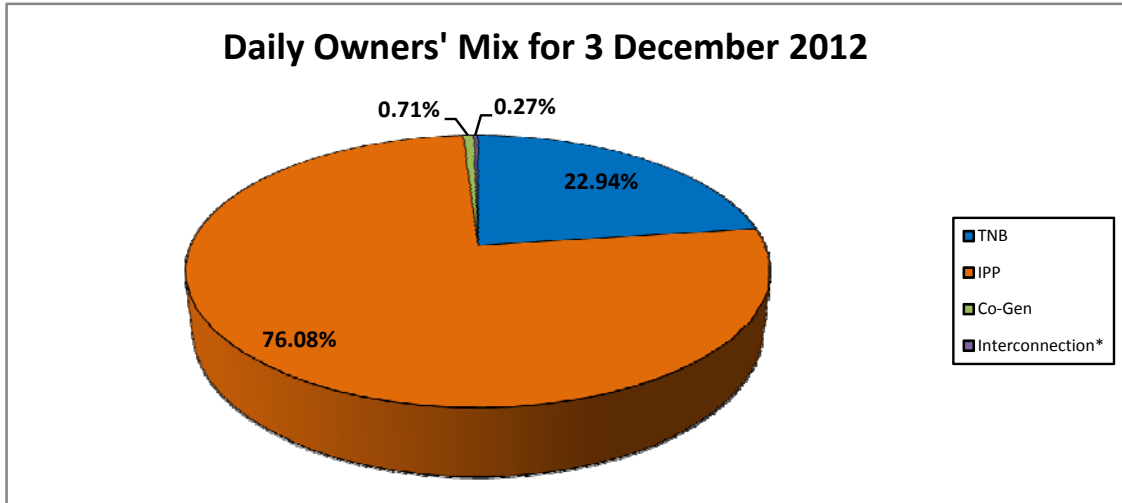

Daily Generation Mix for 3 December 2012

ST-Coal	142,800 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	143,596 MWh
Hydro	9,908 MWh
Distillate	- MWh
Co-Gen	2,116 MWh
SPORE*	168 MWh
EGAT*	636 MWh

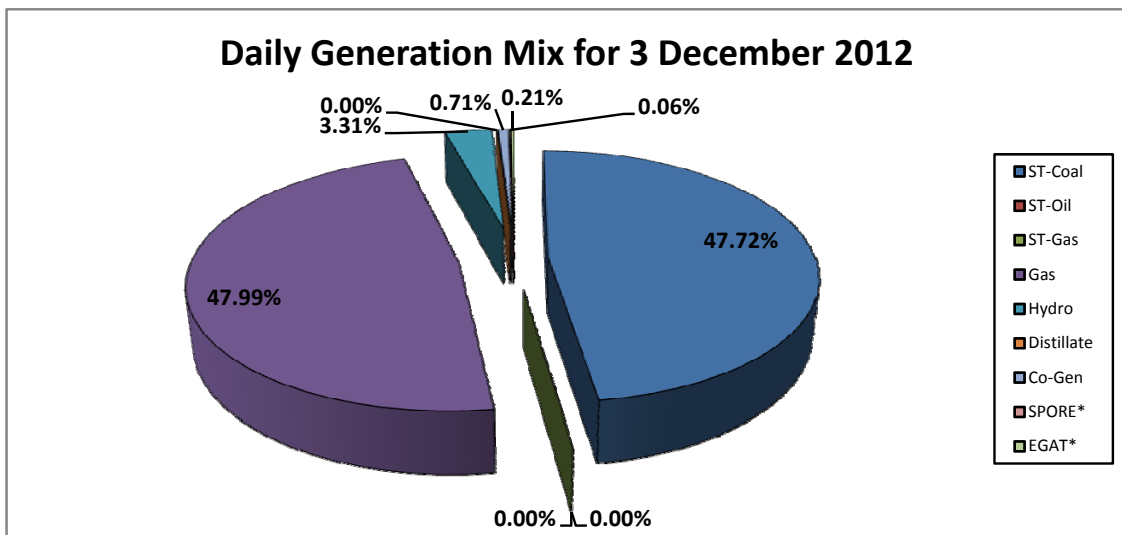

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand