

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 9 December 2012	12,283 MW	12,186 MW	-0.79%	
Energy Demand for 9 December 2012	263.88 GWh	266.21 GWh	0.88%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

10-Dec-12


Daily Owners' Mix for 9 December 2012

TNB	67,364 MWh
IPP	198,174 MWh
Co-Gen	1,474 MWh
Interconnection*	803 MWh

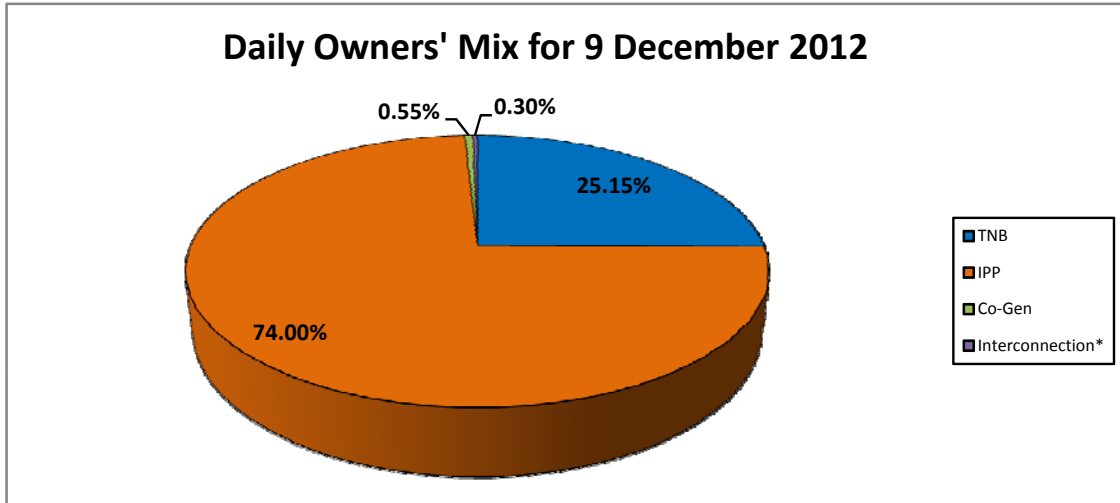

Daily Generation Mix for 9 December 2012

ST-Coal	117,540 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	141,217 MWh
Hydro	6,706 MWh
Distillate	75 MWh
Co-Gen	1,474 MWh
SPORE*	84 MWh
EGAT*	719 MWh

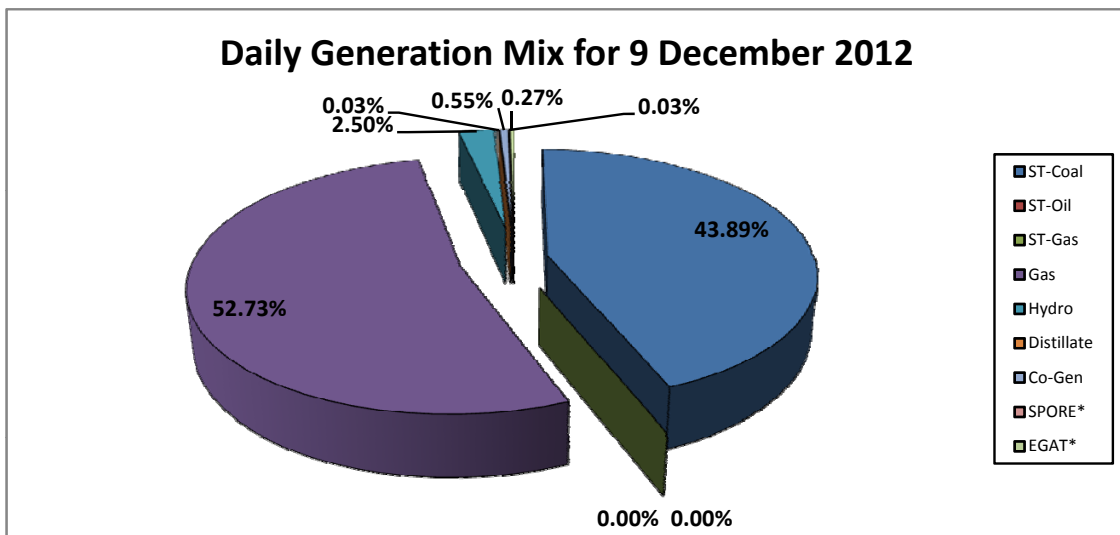

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand