

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 10 December 2012	14,813 MW	14,684 MW	-0.87%	
Energy Demand for 10 December 2012	301.86 GWh	300.69 GWh	-0.39%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

11-Dec-12


Daily Owners' Mix for 10 December 2012

TNB	75,186 MWh
IPP	223,708 MWh
Co-Gen	1,338 MWh
Interconnection*	(457) MWh

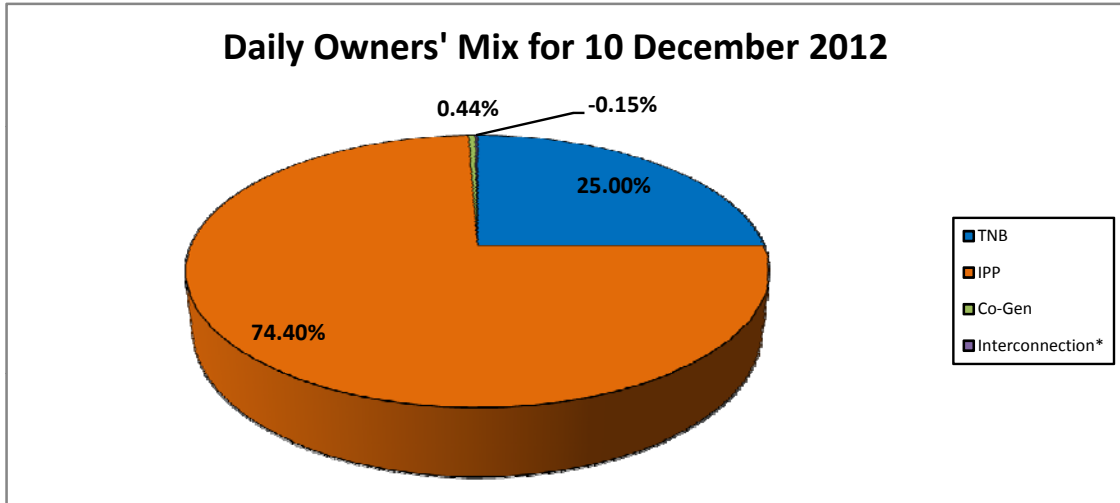

Daily Generation Mix for 10 December 2012

ST-Coal	135,696 MWh
ST-Oil	137 MWh
ST-Gas	- MWh
Gas	152,825 MWh
Hydro	10,236 MWh
Distillate	- MWh
Co-Gen	1,338 MWh
SPORE*	157 MWh
EGAT*	(614) MWh

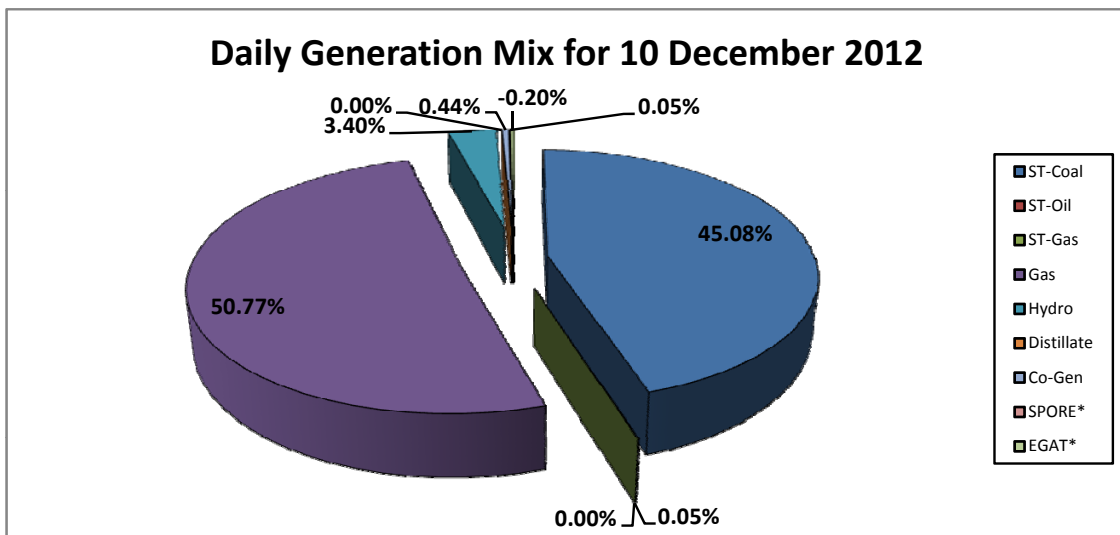

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand