

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 13 December 2012	15,070 MW	14,957 MW	-0.75%	
Energy Demand for 13 December 2012	309.54 GWh	308.09 GWh	-0.47%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

14-Dec-12


Daily Owners' Mix for 13 December 2012

TNB	79,717 MWh
IPP	226,356 MWh
Co-Gen	1,406 MWh
Interconnection*	(612) MWh

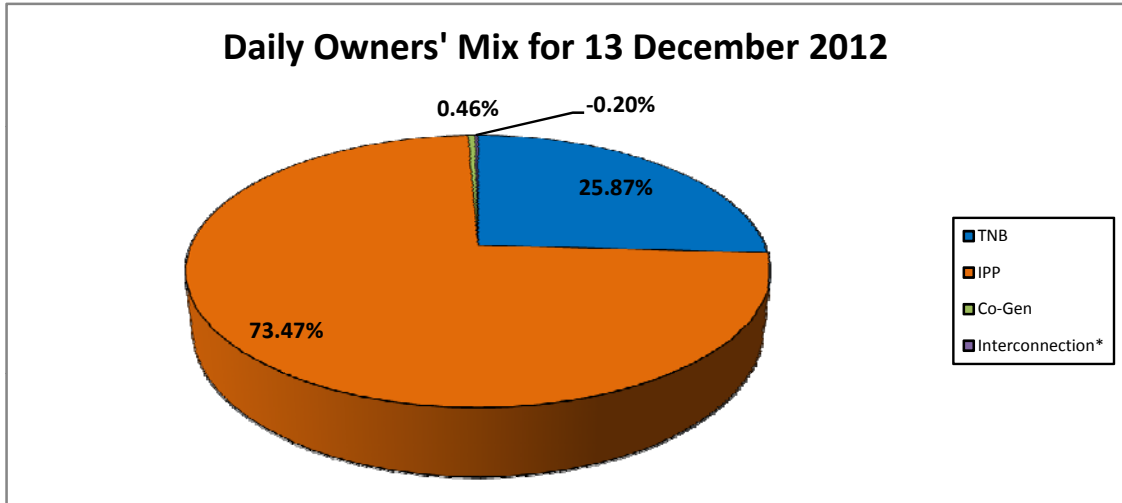

Daily Generation Mix for 13 December 2012

ST-Coal	140,905 MWh
ST-Oil	122 MWh
ST-Gas	- MWh
Gas	156,043 MWh
Hydro	9,003 MWh
Distillate	- MWh
Co-Gen	1,406 MWh
SPORE*	88 MWh
EGAT*	(700) MWh

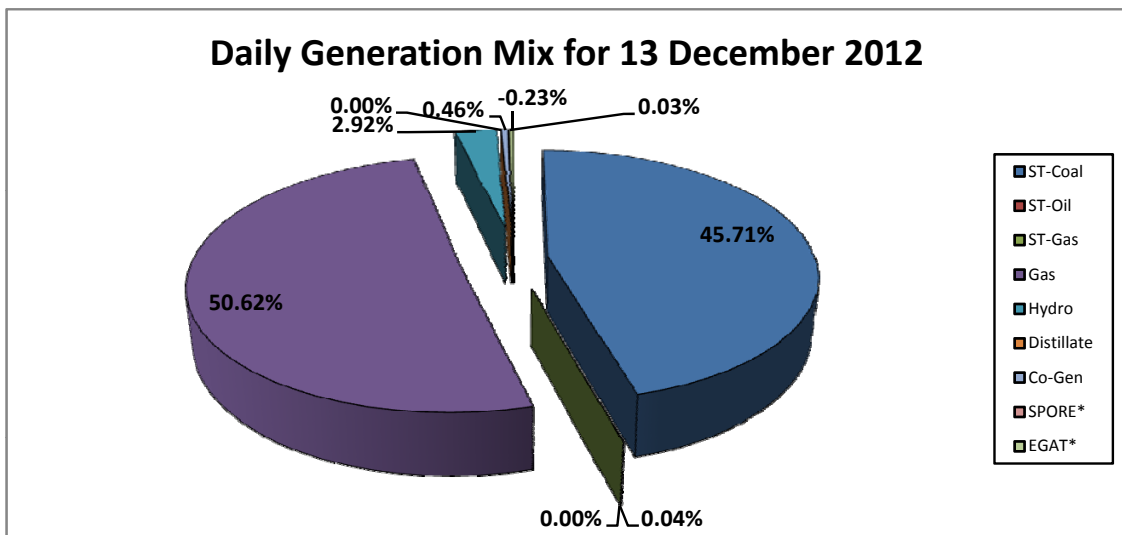

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand