

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 16 December 2012	12,361 MW	12,019 MW	-2.77%	
Energy Demand for 16 December 2012	265.53 GWh	259.75 GWh	-2.18%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

17-Dec-12


Daily Owners' Mix for 16 December 2012

TNB	70,481 MWh
IPP	188,509 MWh
Co-Gen	1,339 MWh
Interconnection*	(426) MWh

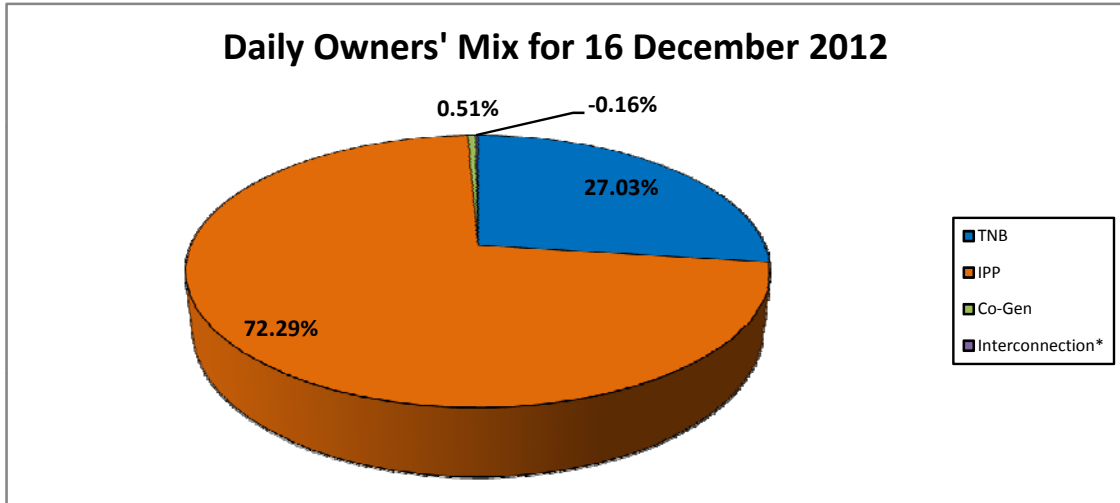

Daily Generation Mix for 16 December 2012

ST-Coal	113,363 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	137,592 MWh
Hydro	8,035 MWh
Distillate	- MWh
Co-Gen	1,339 MWh
SPORE*	270 MWh
EGAT*	(696) MWh

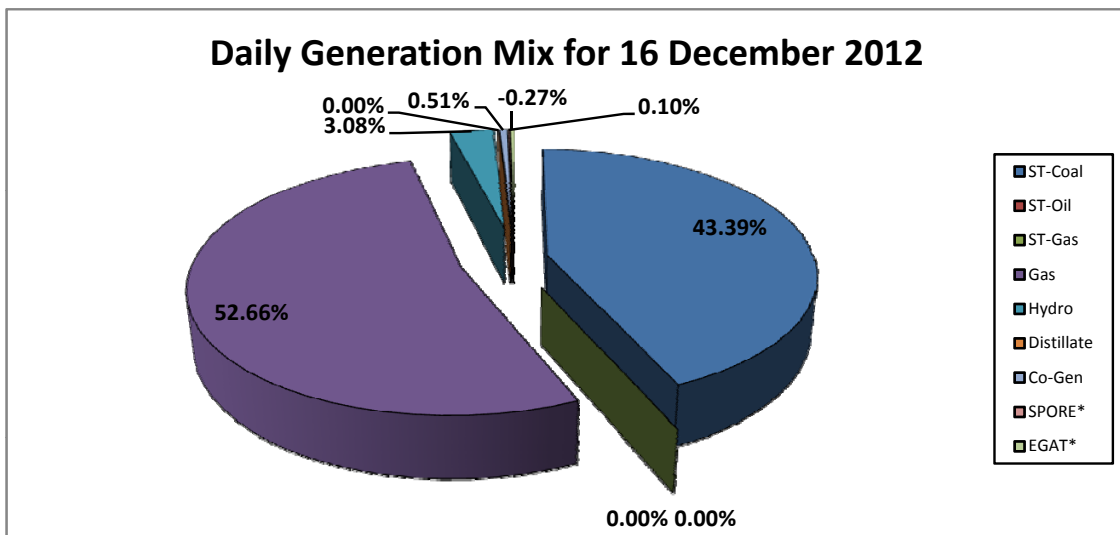

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand