

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 17 December 2012	14,720 MW	14,639 MW	-0.55%	
Energy Demand for 17 December 2012	297.50 GWh	296.56 GWh	-0.32%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

18-Dec-12


Daily Owners' Mix for 17 December 2012

TNB	79,798 MWh
IPP	216,504 MWh
Co-Gen	1,352 MWh
Interconnection*	465 MWh

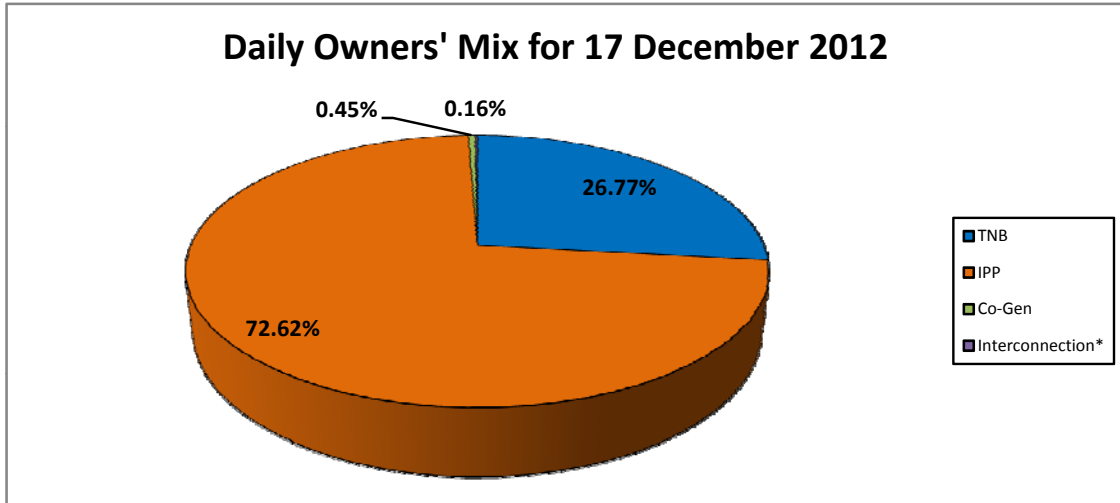

Daily Generation Mix for 17 December 2012

ST-Coal	123,299 MWh
ST-Oil	56 MWh
ST-Gas	- MWh
Gas	160,997 MWh
Hydro	11,950 MWh
Distillate	- MWh
Co-Gen	1,352 MWh
SPORE*	(169) MWh
EGAT*	634 MWh

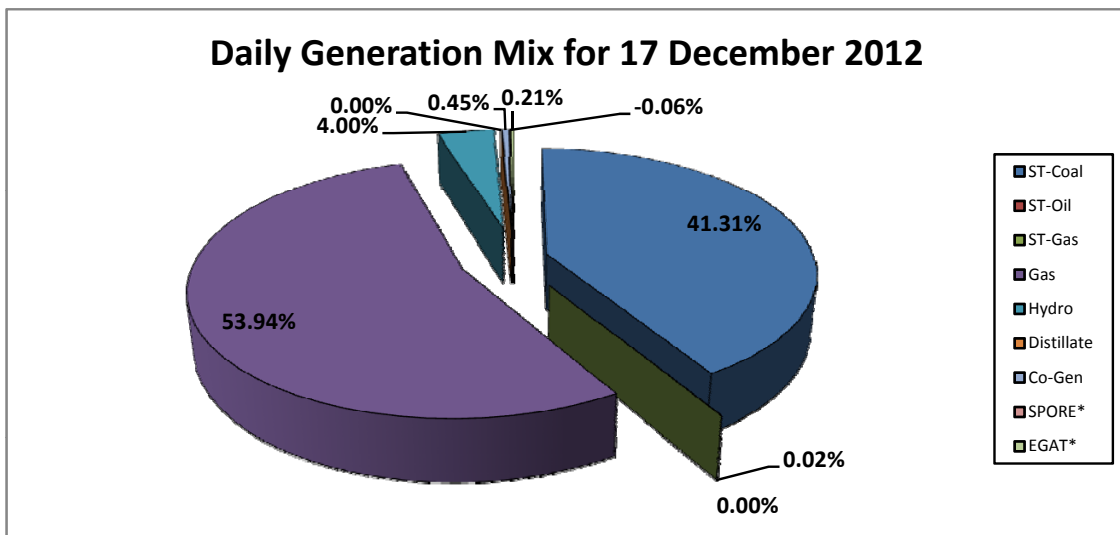

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand