

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 22 December 2012	13,062 MW	12,833 MW	-1.75%	
Energy Demand for 22 December 2012	283.90 GWh	277.98 GWh	-2.09%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

23-Dec-12


Daily Owners' Mix for 22 December 2012

TNB	49,270 MWh
IPP	227,779 MWh
Co-Gen	1,583 MWh
Interconnection*	649 MWh

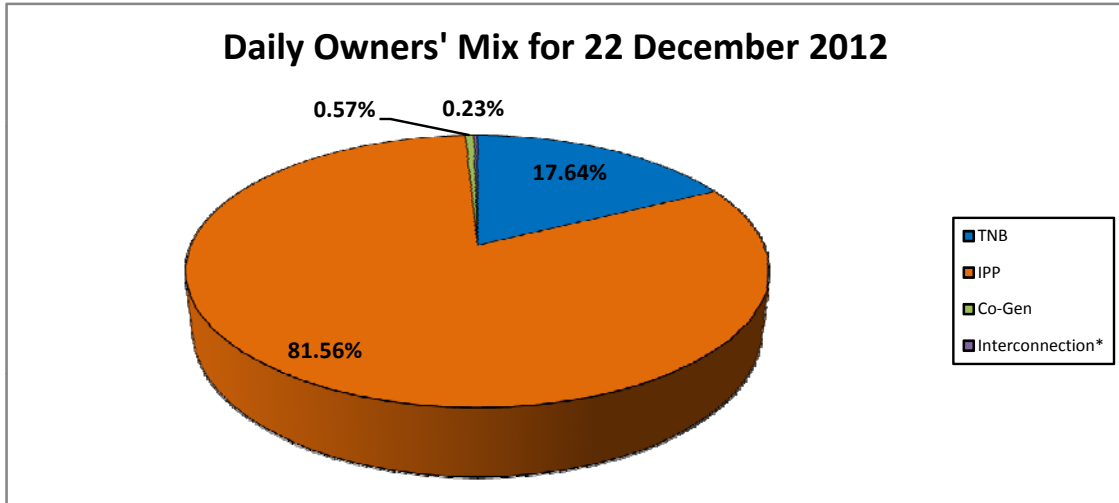

Daily Generation Mix for 22 December 2012

ST-Coal	140,970 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	128,391 MWh
Hydro	7,688 MWh
Distillate	- MWh
Co-Gen	1,583 MWh
SPORE*	(75) MWh
EGAT*	724 MWh

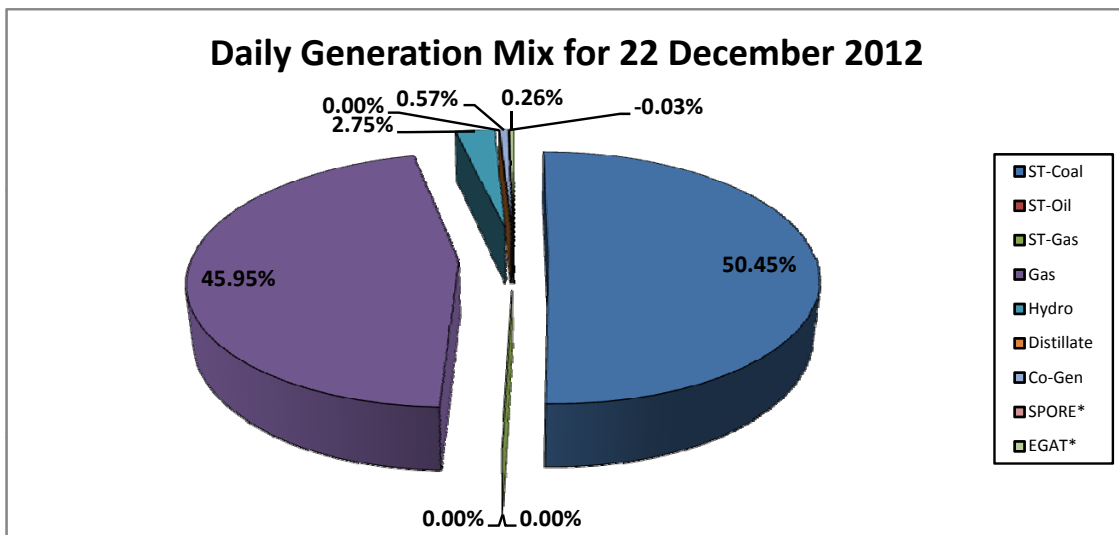

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand