

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 28 December 2012	14,456 MW	14,376 MW	-0.55%	
Energy Demand for 28 December 2012	303.83 GWh	302.05 GWh	-0.59%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

29-Dec-12


Daily Owners' Mix for 28 December 2012

TNB	65,916 MWh
IPP	234,079 MWh
Co-Gen	1,471 MWh
Interconnection*	(580) MWh

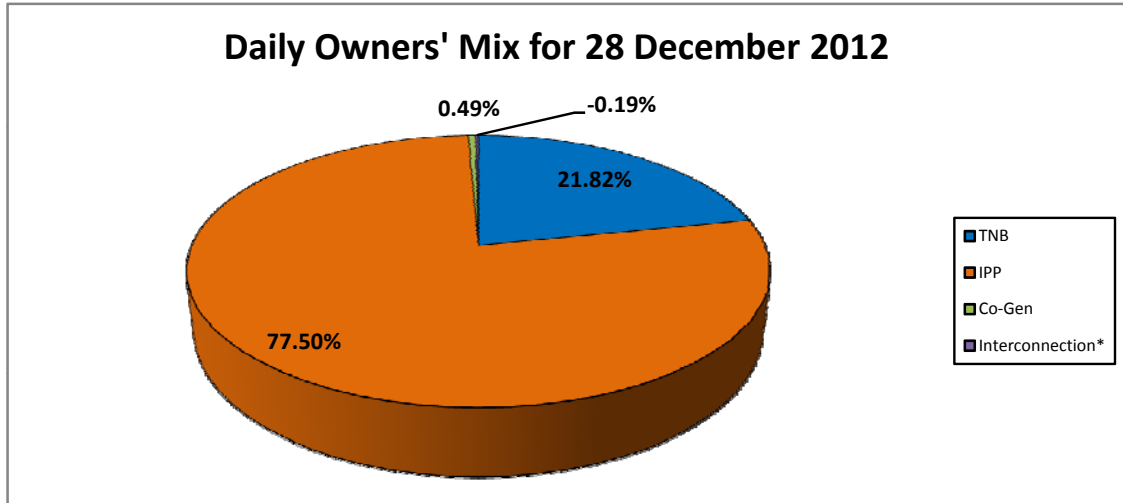

Daily Generation Mix for 28 December 2012

ST-Coal	147,127 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	141,300 MWh
Hydro	11,568 MWh
Distillate	- MWh
Co-Gen	1,471 MWh
SPORE*	117 MWh
EGAT*	(697) MWh

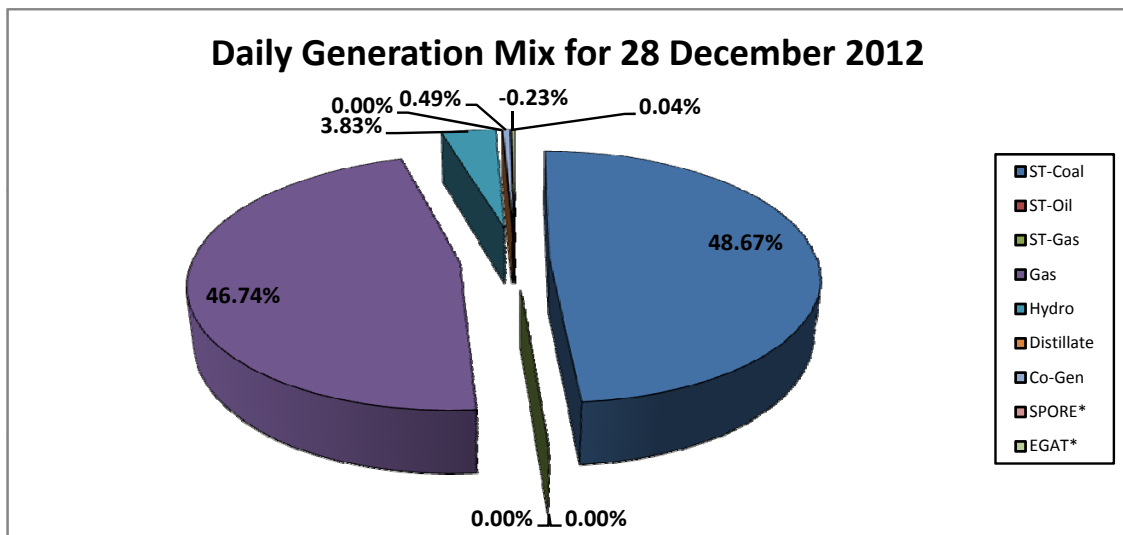

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand