

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 29 December 2012	12,896 MW	13,097 MW	1.56%	
Energy Demand for 29 December 2012	281.49 GWh	282.96 GWh	0.52%	
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90%	*New MD
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

30-Dec-12


Daily Owners' Mix for 29 December 2012

TNB	53,414 MWh
IPP	227,519 MWh
Co-Gen	1,503 MWh
Interconnection*	(525) MWh

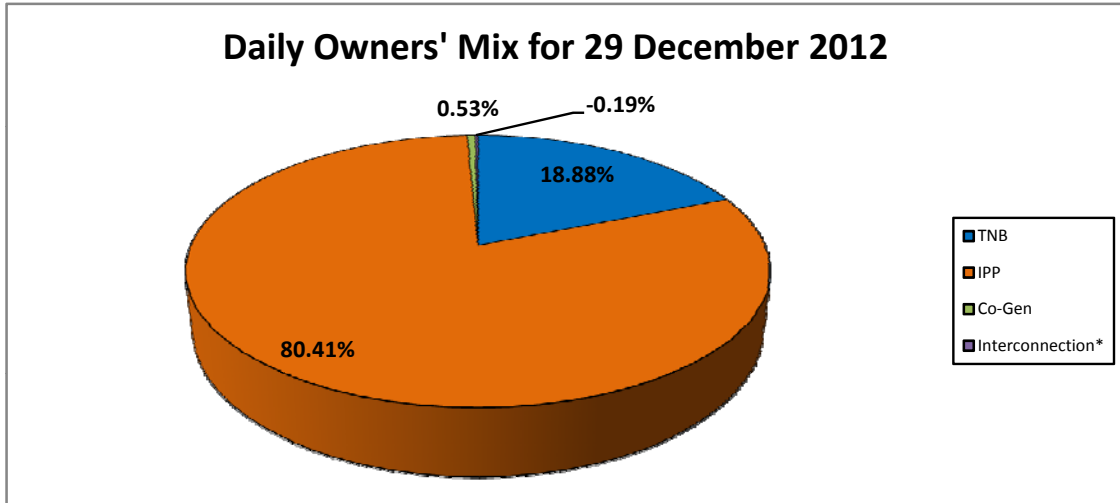

Daily Generation Mix for 29 December 2012

ST-Coal	139,705 MWh
ST-Oil	- MWh
ST-Gas	- MWh
Gas	131,106 MWh
Hydro	10,122 MWh
Distillate	- MWh
Co-Gen	1,503 MWh
SPORE*	173 MWh
EGAT*	(698) MWh

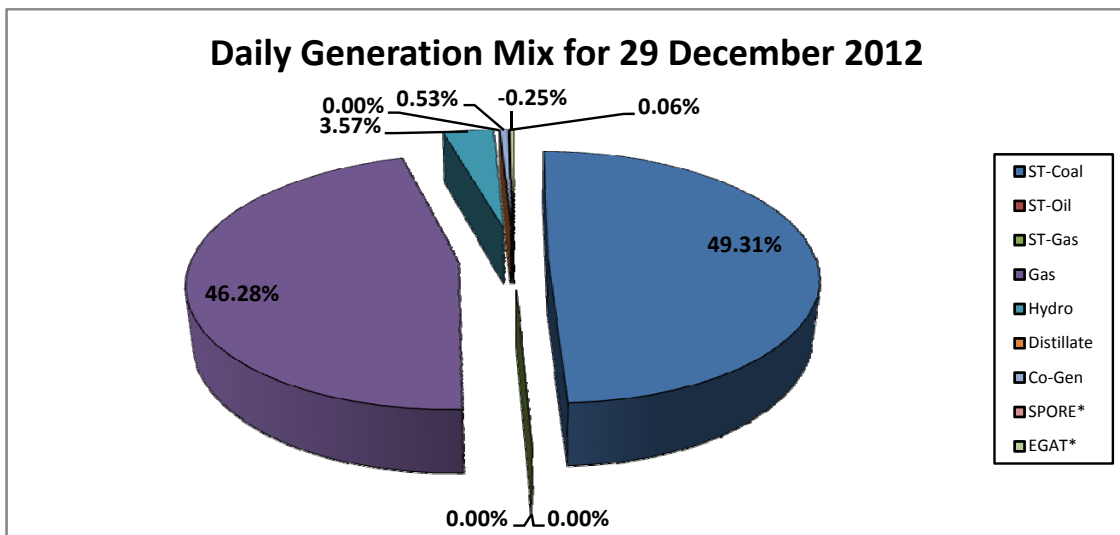

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand