

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 15 February 2013	13,229 MW	13,333 MW	0.79%
Energy Demand for 15 February 2013	285.25 GWh	286.28 GWh	0.36%
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90% <b>*New MD</b>
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60% <b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

16-Feb-13


**Daily Owners' Mix for 15 February 2013**

TNB	61,095	MWh
IPP	222,333	MWh
Co-Gen	2,220	MWh
Interconnection*	(632)	MWh

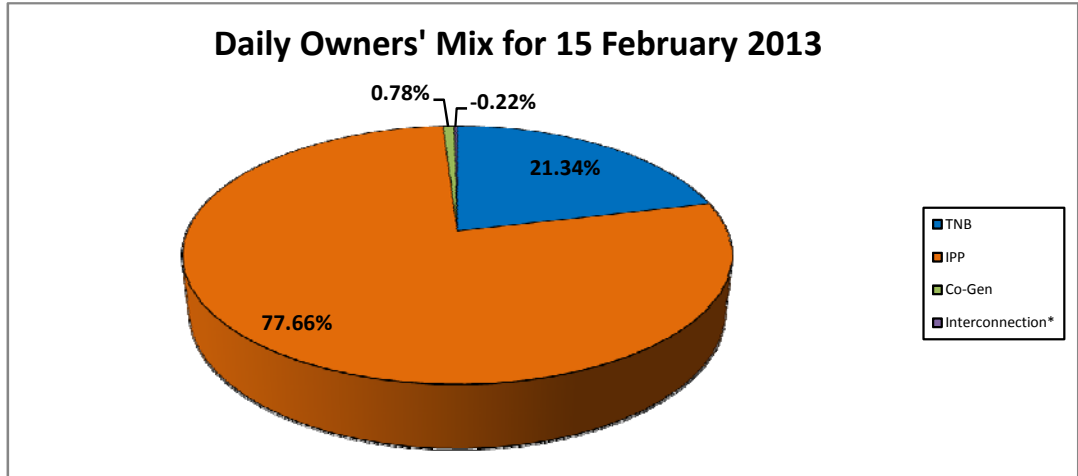

**Daily Generation Mix for 15 February 2013**

ST-Coal	140,055	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	125,856	MWh
Hydro	17,517	MWh
Distillate	-	MWh
Co-Gen	2,220	MWh
SPORE*	66	MWh
EGAT*	(698)	MWh

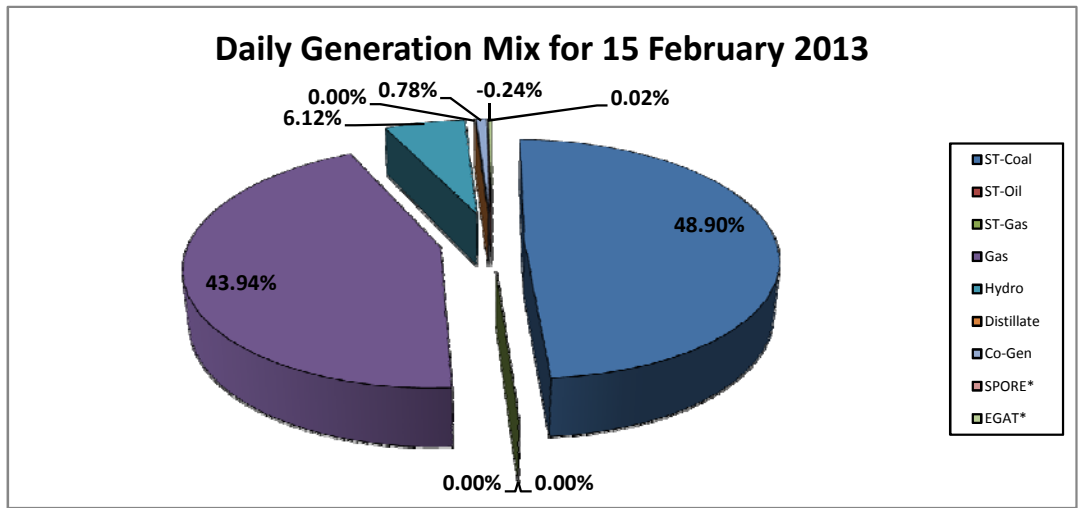

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand