

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 20 February 2013	14,650 MW	14,724 MW	0.51%
Energy Demand for 20 February 2013	304.28 GWh	303.50 GWh	-0.26%
Highest Maximum Demand (20 June 2012)	15,685 MW	15,826 MW	0.90% <b>*New MD</b>
Highest Daily Energy Demand (20 June 2012)	326.75 GWh	328.72 GWh	0.60% <b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-Feb-13


**Daily Owners' Mix for 20 February 2013**

TNB	62,746	MWh
IPP	237,545	MWh
Co-Gen	2,374	MWh
Interconnection*	(816)	MWh

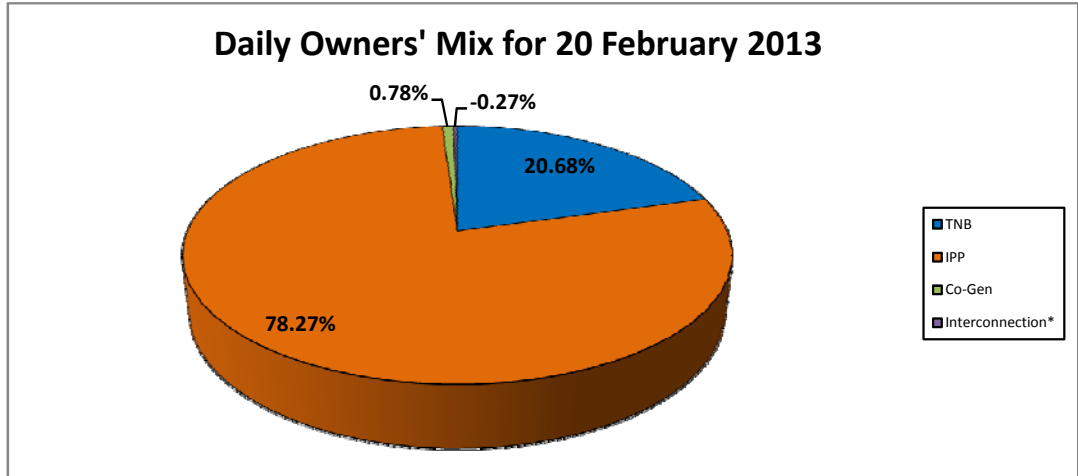

**Daily Generation Mix for 20 February 2013**

ST-Coal	146,950	MWh
ST-Oil	-	MWh
ST-Gas	-	MWh
Gas	139,019	MWh
Hydro	14,322	MWh
Distillate	-	MWh
Co-Gen	2,374	MWh
SPORE*	(117)	MWh
EGAT*	(699)	MWh

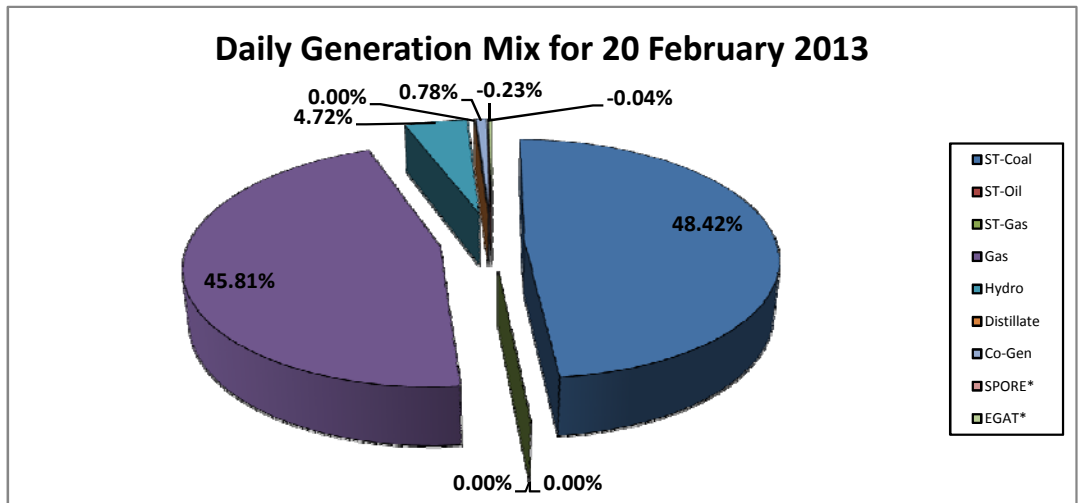

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand