

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 20 May 2013	15,719 MW	16,128 MW	2.60%	
Energy Demand for 20 May 2013	323.29 GWh	330.57 GWh	2.25%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

21-May-13


Daily Owners' Mix for 20 May 2013

TNB	73,075 MWh
IPP	251,899 MWh
Co-Gen	1,463 MWh
Interconnection*	(4,135) MWh

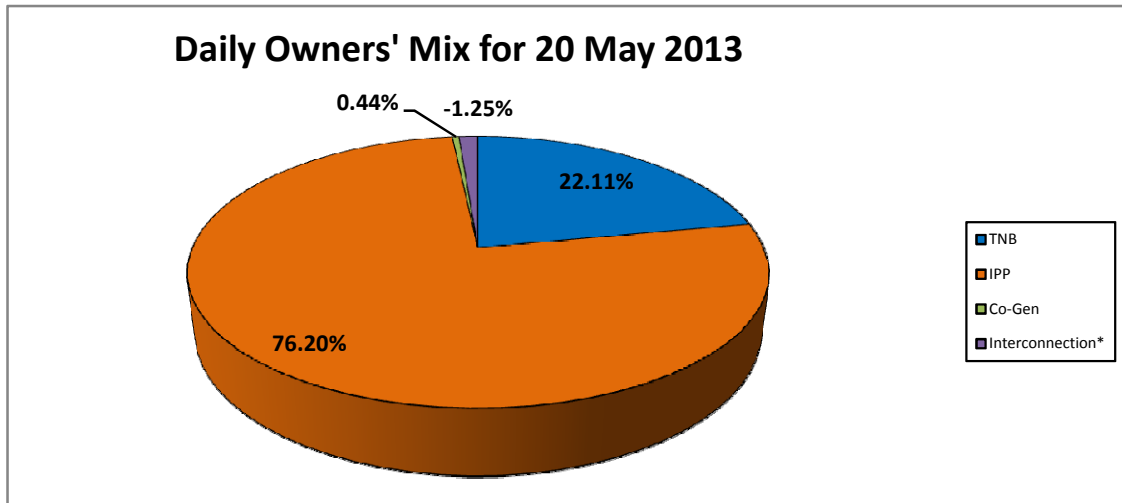

Daily Generation Mix for 20 May 2013

ST-Coal	131,212 MWh
ST-Oil	7,806 MWh
ST-Gas	- MWh
Gas	134,118 MWh
Hydro	18,839 MWh
Distillate	32,999 MWh
Co-Gen	1,463 MWh
SPORE*	(4,857) MWh
EGAT*	722 MWh

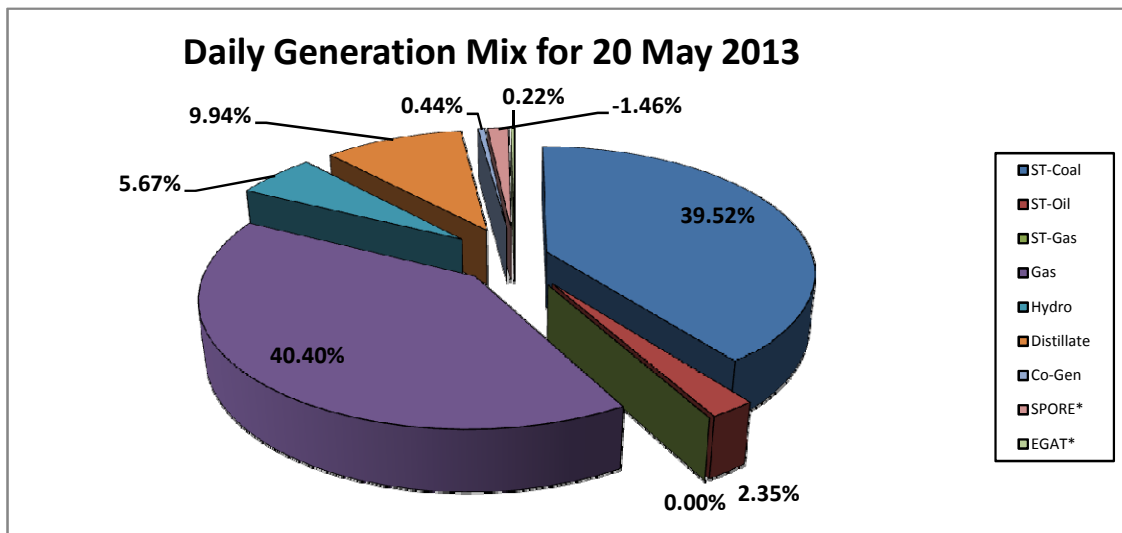

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand