

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 2 June 2013	13,280 MW	12,867 MW	-3.11%
Energy Demand for 2 June 2013	278.28 GWh	271.71 GWh	-2.36%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% *New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29% *New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

03-Jun-13


Daily Owners' Mix for 2 June 2013

TNB	55,852 MWh
IPP	213,880 MWh
Co-Gen	2,104 MWh
Interconnection*	131 MWh

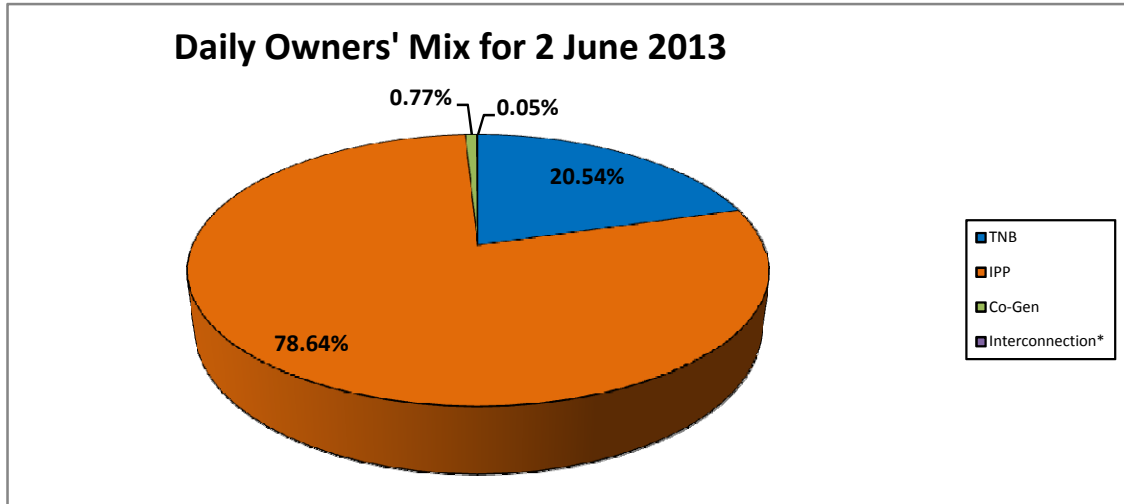

Daily Generation Mix for 2 June 2013

ST-Coal	124,310 MWh
ST-Oil	5,566 MWh
ST-Gas	- MWh
Gas	127,167 MWh
Hydro	12,689 MWh
Distillate	- MWh
Co-Gen	2,104 MWh
SPORE*	(324) MWh
EGAT*	455 MWh

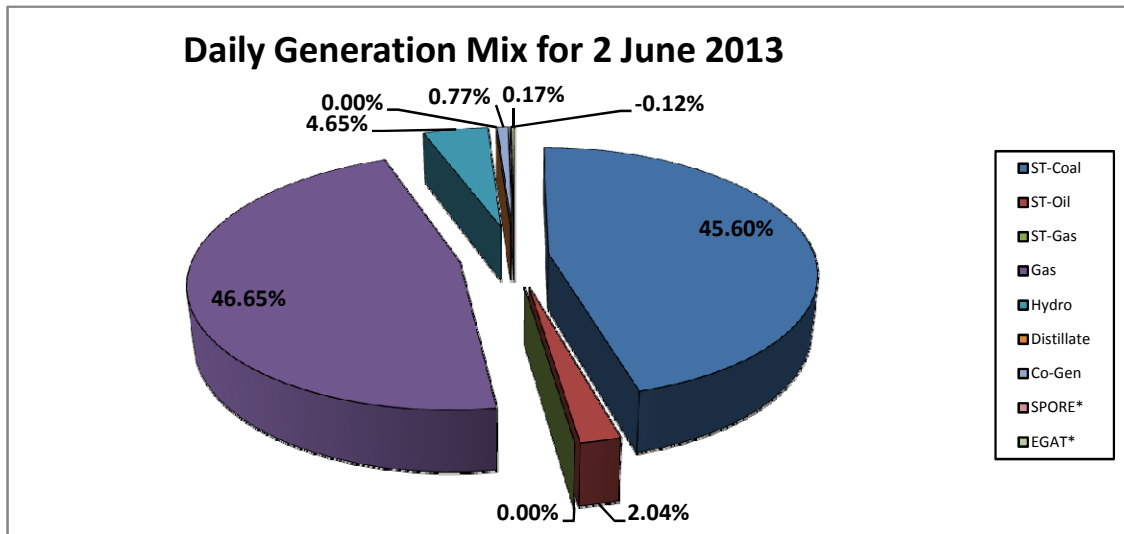

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand