

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 3 June 2013	16,112 MW	15,882 MW	-1.43%
Energy Demand for 3 June 2013	326.82 GWh	324.34 GWh	-0.76%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% <b>*New MD</b>
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29% <b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

04-Jun-13


**Daily Owners' Mix for 3 June 2013**

TNB	76,873 MWh
IPP	244,683 MWh
Co-Gen	2,116 MWh
Interconnection*	(668) MWh

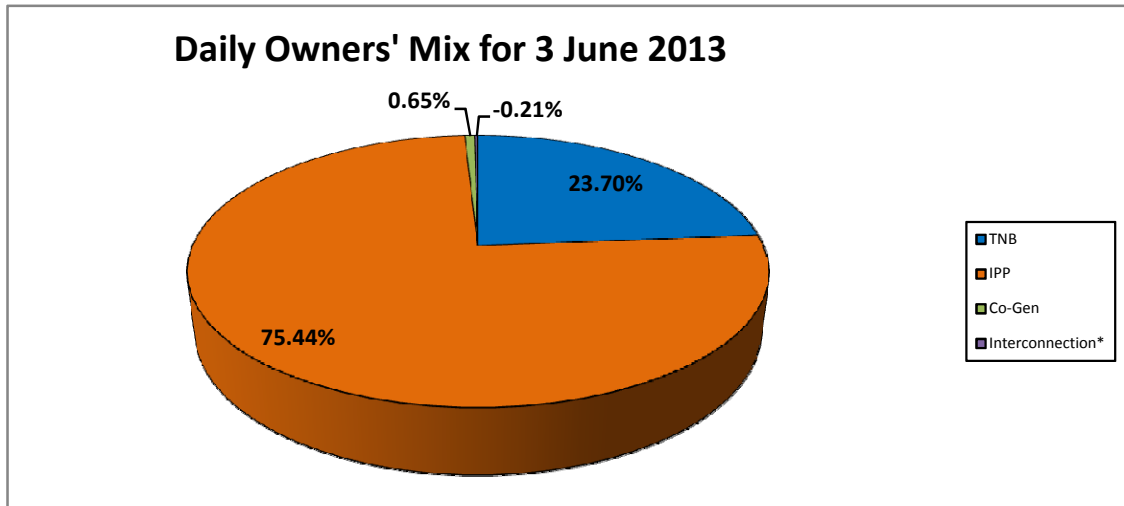

**Daily Generation Mix for 3 June 2013**

ST-Coal	125,166 MWh
ST-Oil	5,214 MWh
ST-Gas	- MWh
Gas	153,662 MWh
Hydro	19,125 MWh
Distillate	18,389 MWh
Co-Gen	2,116 MWh
SPORE*	33 MWh
EGAT*	(701) MWh

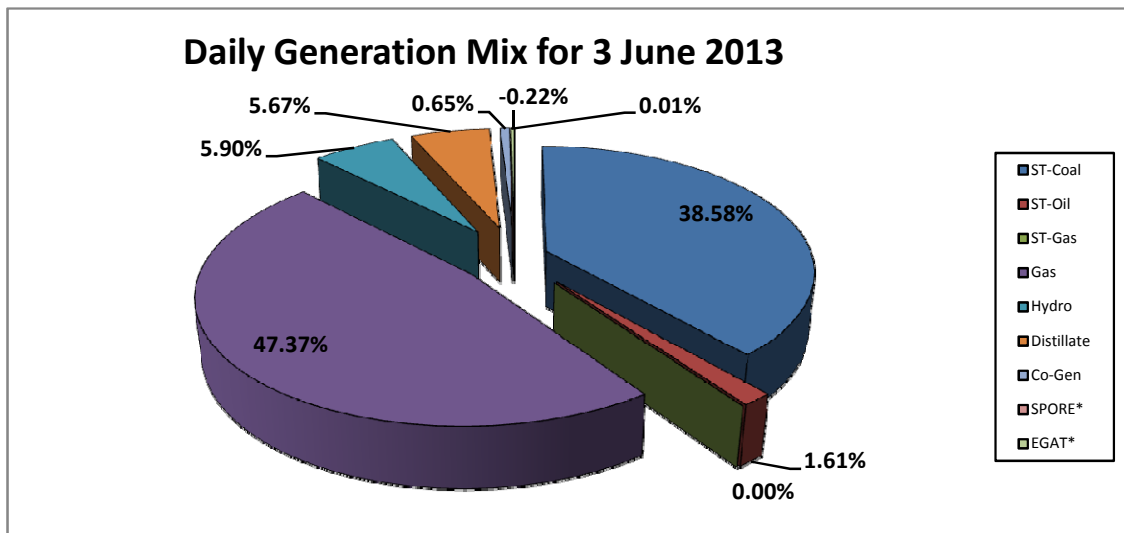

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand