

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 4 June 2013	16,075 MW	15,984 MW	-0.57%	
Energy Demand for 4 June 2013	335.80 GWh	331.56 GWh	-1.26%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

05-Jun-13


Daily Owners' Mix for 4 June 2013

TNB	83,831 MWh
IPP	245,125 MWh
Co-Gen	2,102 MWh
Interconnection*	(500) MWh

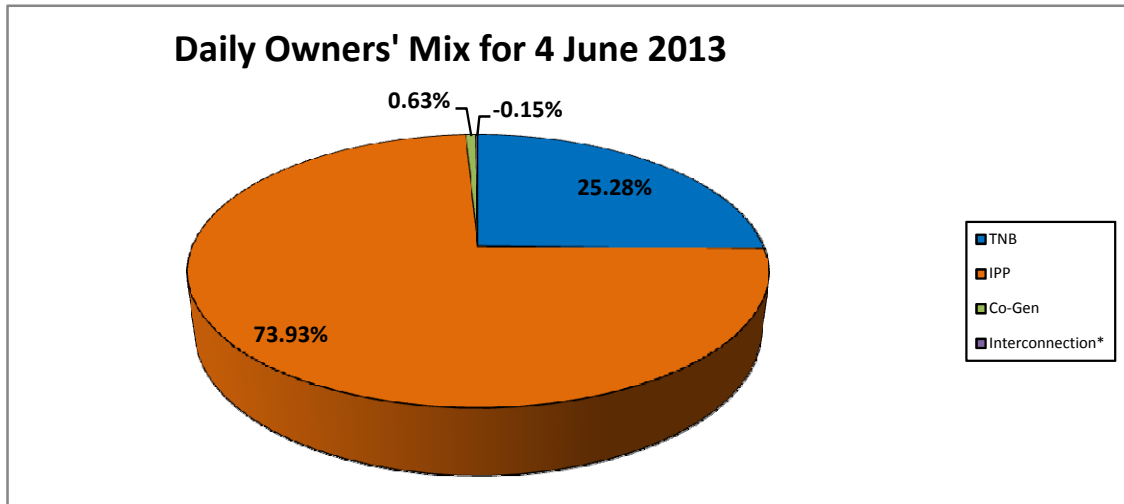

Daily Generation Mix for 4 June 2013

ST-Coal	121,546 MWh
ST-Oil	6,451 MWh
ST-Gas	43 MWh
Gas	141,592 MWh
Hydro	18,886 MWh
Distillate	40,438 MWh
Co-Gen	2,102 MWh
SPORE*	196 MWh
EGAT*	(696) MWh

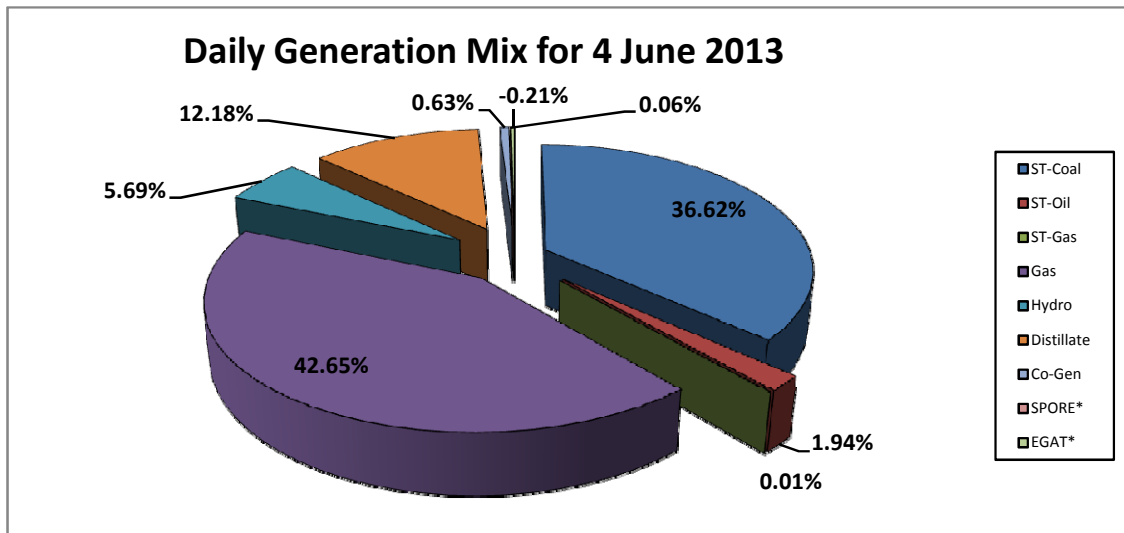

*Negative = energy is imported from Singapore and Thailand

Positive = energy is exported to Singapore and Thailand