

GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE	
Maximum Demand for 8 June 2013	14,015 MW	14,017 MW	0.01%	
Energy Demand for 8 June 2013	305.30 GWh	310.20 GWh	1.60%	
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62%	*New MD
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29%	*New Energy

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

09-Jun-13


Daily Owners' Mix for 8 June 2013

TNB	61,881 MWh
IPP	245,533 MWh
Co-Gen	2,080 MWh
Interconnection*	(711) MWh

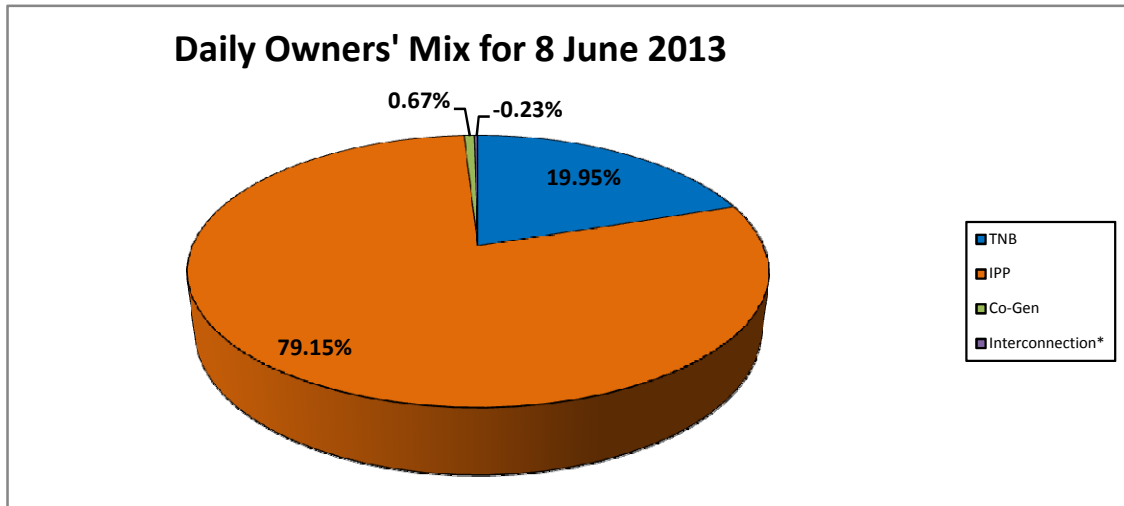

Daily Generation Mix for 8 June 2013

ST-Coal	124,784 MWh
ST-Oil	5,628 MWh
ST-Gas	- MWh
Gas	163,895 MWh
Hydro	13,107 MWh
Distillate	- MWh
Co-Gen	2,080 MWh
SPORE*	(13) MWh
EGAT*	(698) MWh

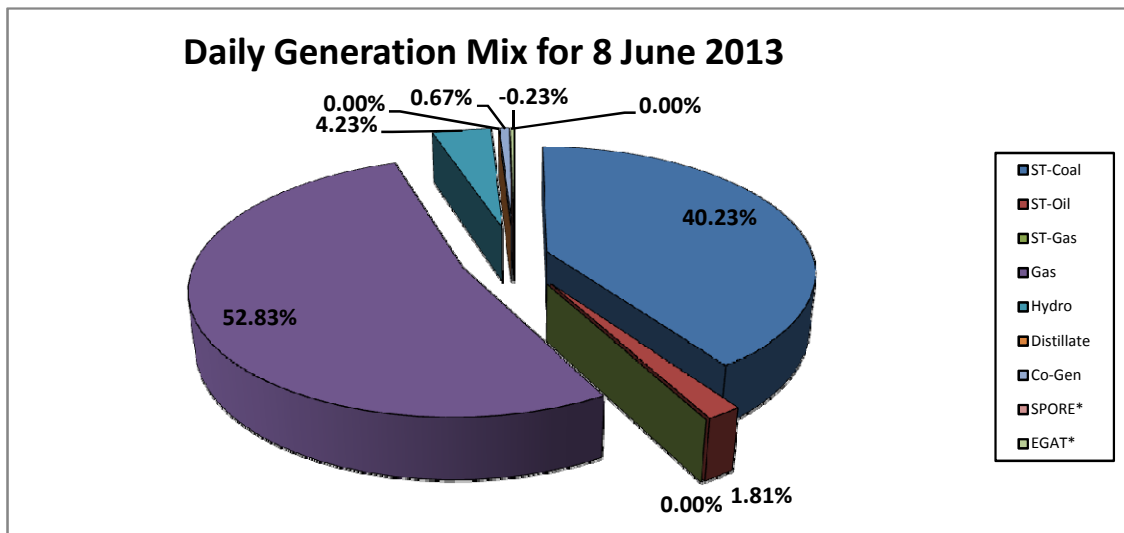

*Negative = energy is imported from Singapore and Thailand
 Positive = energy is exported to Singapore and Thailand