

## GRID SYSTEM OPERATION SUMMARY (PENINSULAR MALAYSIA)

	FORECAST	ACTUAL	VARIANCE
Maximum Demand for 14 June 2013	15,487 MW	15,654 MW	1.08%
Energy Demand for 14 June 2013	325.81 GWh	328.64 GWh	0.87%
Highest Maximum Demand (13 May 2013)	16,298 MW	16,562 MW	1.62% <b>*New MD</b>
Highest Daily Energy Demand (14 May 2013)	345.42 GWh	344.42 GWh	-0.29% <b>*New Energy</b>

Prepared by:

Electricity Market Operations


Electricity Supply & Market Regulations Dept.

Energy Commission Malaysia

15-Jun-13


**Daily Owners' Mix for 14 June 2013**

TNB	69,490 MWh
IPP	256,533 MWh
Co-Gen	2,103 MWh
Interconnection*	(482) MWh

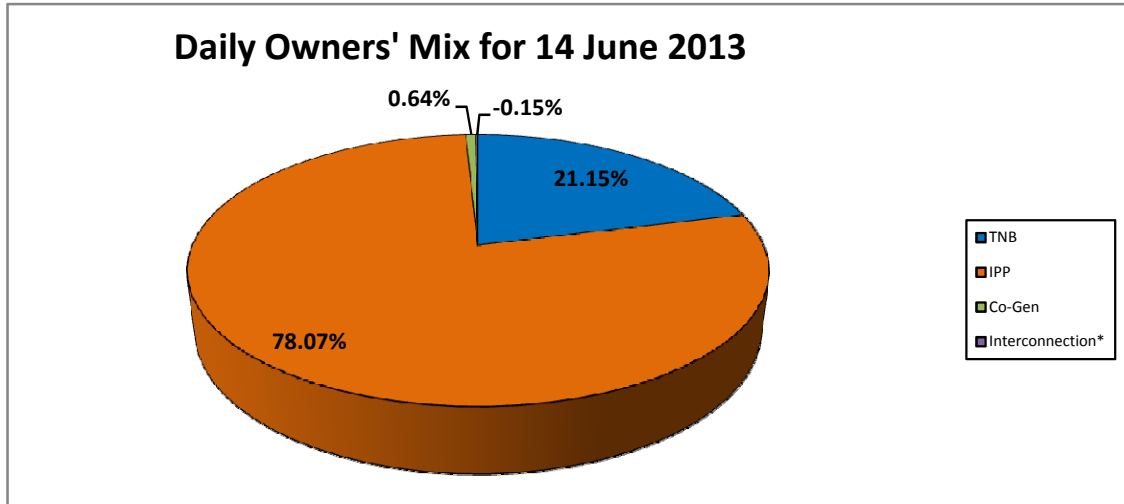

**Daily Generation Mix for 14 June 2013**

ST-Coal	136,095 MWh
ST-Oil	- MWh
ST-Gas	5,332 MWh
Gas	174,442 MWh
Hydro	10,154 MWh
Distillate	- MWh
Co-Gen	2,103 MWh
SPORE*	216 MWh
EGAT*	(698) MWh

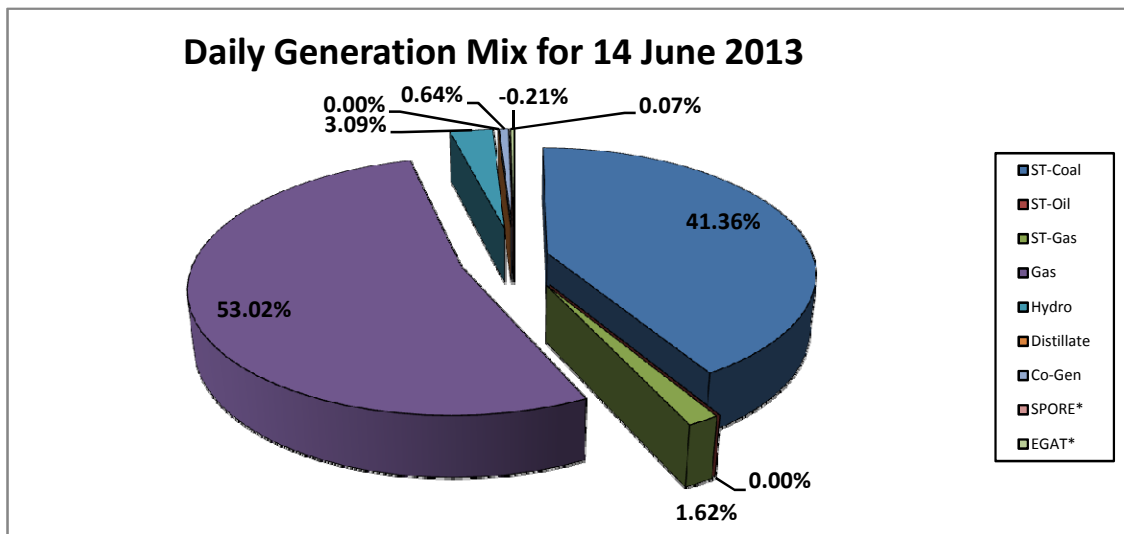

\*Negative = energy is imported from Singapore and Thailand  
 Positive = energy is exported to Singapore and Thailand